



MIAMI-DADE COUNTY
 PRODUCT CONTROL SECTION
 11805 SW 26 Street, Room 208
 Miami, Florida 33175-2474
 T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
 BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

Record-USA, Inc.
 4324 Phil Hargett Court
 Monroe, NC 28110

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County PERA -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. PERA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "5400" Aluminum Automatic Sliding Glass Door w/ Breakout-LMI

APPROVAL DOCUMENT: Drawing No. 14-2163 (former 09-REU-0001), titled "Series 5400 Automatic Sliding Glass Door", sheets 1 through 23 of 23 prepared by Engineering Express, dated 02/12/15, signed and sealed by Frank L. Bernardo, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control section.

MISSILE IMPACT RATING: Large and Small Missile Impact

LIMITATIONS:

1. See Head and Sill anchor Layout in sheet 4. The Jamb anchors OC spacing not to exceed 12".
2. Not approved where water infiltration is required.
3. Electrical/ Electronic functions are not part of this approval and to be reviewed by appropriate Bldg. official
4. Full length steel channel reinforcements at stiles are required per sheet 10.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and series and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises & renews** NOA # 12-0403.06 and consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



NOA No. 15-0316.04
 Expiration Date: March 17, 2020
 Approval Date: June 11, 2015

Handwritten signature and date: 6/11/15

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections (submitted under files, see below)
2. Drawing No. **14-2163** (former **09-REU-0001**), titled "Series 5400 Automatic Sliding Glass Door", sheets 1 through 23 of 23 prepared by Engineering Express, dated 02/12/15, signed and sealed by Frank L. Bernando, P.E.

B. TESTS (submitted under files # **12-0403.06/#09-0712.12**)

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94 (**0.29 cfm/ft²@1.57PSF**)
 - 2) Uniform Static Air Pressure Test, per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94 (Not Performed)
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94

along with installation diagram of aluminum automatic entrance door, prepared by American Testing Lab, Inc. Test Report No. **ATLNC 0428.01-08**, dated 04/29/09, signed and sealed by David Johnson, P.E.

Note: This test report has been revised by an addendum letter dated 01/20/10, issued by American Testing Lab, signed and sealed by David Johnson, P.E.

C. CALCULATIONS

1. Anchor Verification Calculations, complying w/ FBC-2014, dated 02/09/15, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E.
2. Glazing complies w/ ASTM E-1300-02, -04 & -09.

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. #**14-0423.11** issued to Oldcastle Building Envelope, Inc.(NJ) for "**StormGlass: Saflex CP-(VS-XX) interlayer w/ PET core**", expiring on 12/11/18.

F. STATEMENTS

1. Statement letter of conformance to FBC 2014 and letter of no financial interest, prepared by Engineering Express, both dated 02/10/15, signed and sealed by Frank L. Bennardo, P.E.
2. Lab compliance as part of the above referenced test report.

G. OTHER

1. This NOA revises & renews NOA # **12-0403.06**, expiring on 03/17/20.
2. Test proposal #**08-0238**, approved by BCCO.



Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No. 15-0316.04


Expiration Date: March 17, 2020

Approval Date: June 11, 2015

SERIES 5400 AUTOMATIC SLIDING GLASS DOOR

LARGE MISSILE IMPACT RESISTANT

FRANK L. BENNARDO, P.E.
 LICENSE NO. 46549
 02/11/2015
 PROFESSIONAL ENGINEER
 STATE OF FLORIDA
 160 SW 12th AVENUE, #1100
 DEERFIELD BEACH, FL 33442
 PH: (954) 354-0660 FAX: (954) 354-0663
 WWW.ENGP.COM
 CERT. OF AUTH. #9886
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

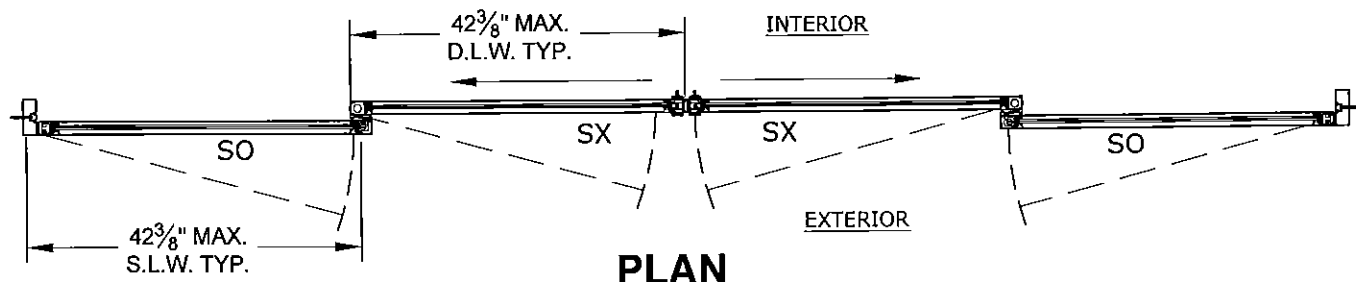


DESIGN PRESSURE RATING		IMPACT RATING
POSITIVE	+65 PSF	LARGE AND SMALL MISSILE IMPACT
NEGATIVE	-70 PSF	

NOTE: THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE THE WATER REQUIREMENT IS NOT NEEDED.

GENERAL NOTES

1. THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE FIFTH EDITION (2014), FOR USE WITHIN AND OUTSIDE THE HIGH VELOCITY HURRICANE ZONE, PER TAS 201, 202, AND 203 STANDARDS.
2. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
3. POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE.
4. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN WITHIN THE HVHZ, A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE SHALL BE APPLIED FOR AND SECURED FROM THE MIAMI-DADE BUILDING CODE COMPLIANCE OFFICE PRODUCT CONTROL DIVISION. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN OUTSIDE THE HVHZ, THE BUILDING OFFICIAL MAY REQUIRE A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE BE OBTAINED, OR THAT SITE SPECIFIC DOCUMENTS BE PREPARED, SIGNED, DATED AND SEALED BY A LICENSED ENGINEER OR REGISTERED ARCHITECT, WHICH DETAIL AND JUSTIFY THE DEVIATION.
5. PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
6. ALL EXTRUSIONS SHALL BE 6063-T5 ALUMINUM ALLOY, UNLESS NOTED OTHERWISE.
7. EXTERIOR SEAM OF FRAME CORNERS SHALL BE SEALED WITH SILICONE.
8. ALL BOLTS & WASHERS SHALL BE ZINC COATED STEEL, GALVANIZED STEEL, OR STAINLESS STEEL WITH A MINIMUM TENSILE YIELD STRENGTH OF 60 KSI. ALL 3/16" Ø OR 1/4" Ø POP RIVETS SHALL BE 5056-H32 ALUMINUM ALLOY OR STRONGER UNLESS OTHERWISE NOTED.
9. ALL STEEL IN CONTACT WITH ALUMINUM SHALL BE PAINTED OR PLATED AS PRESCRIBED IN THE ABOVE-NOTED BUILDING CODE.

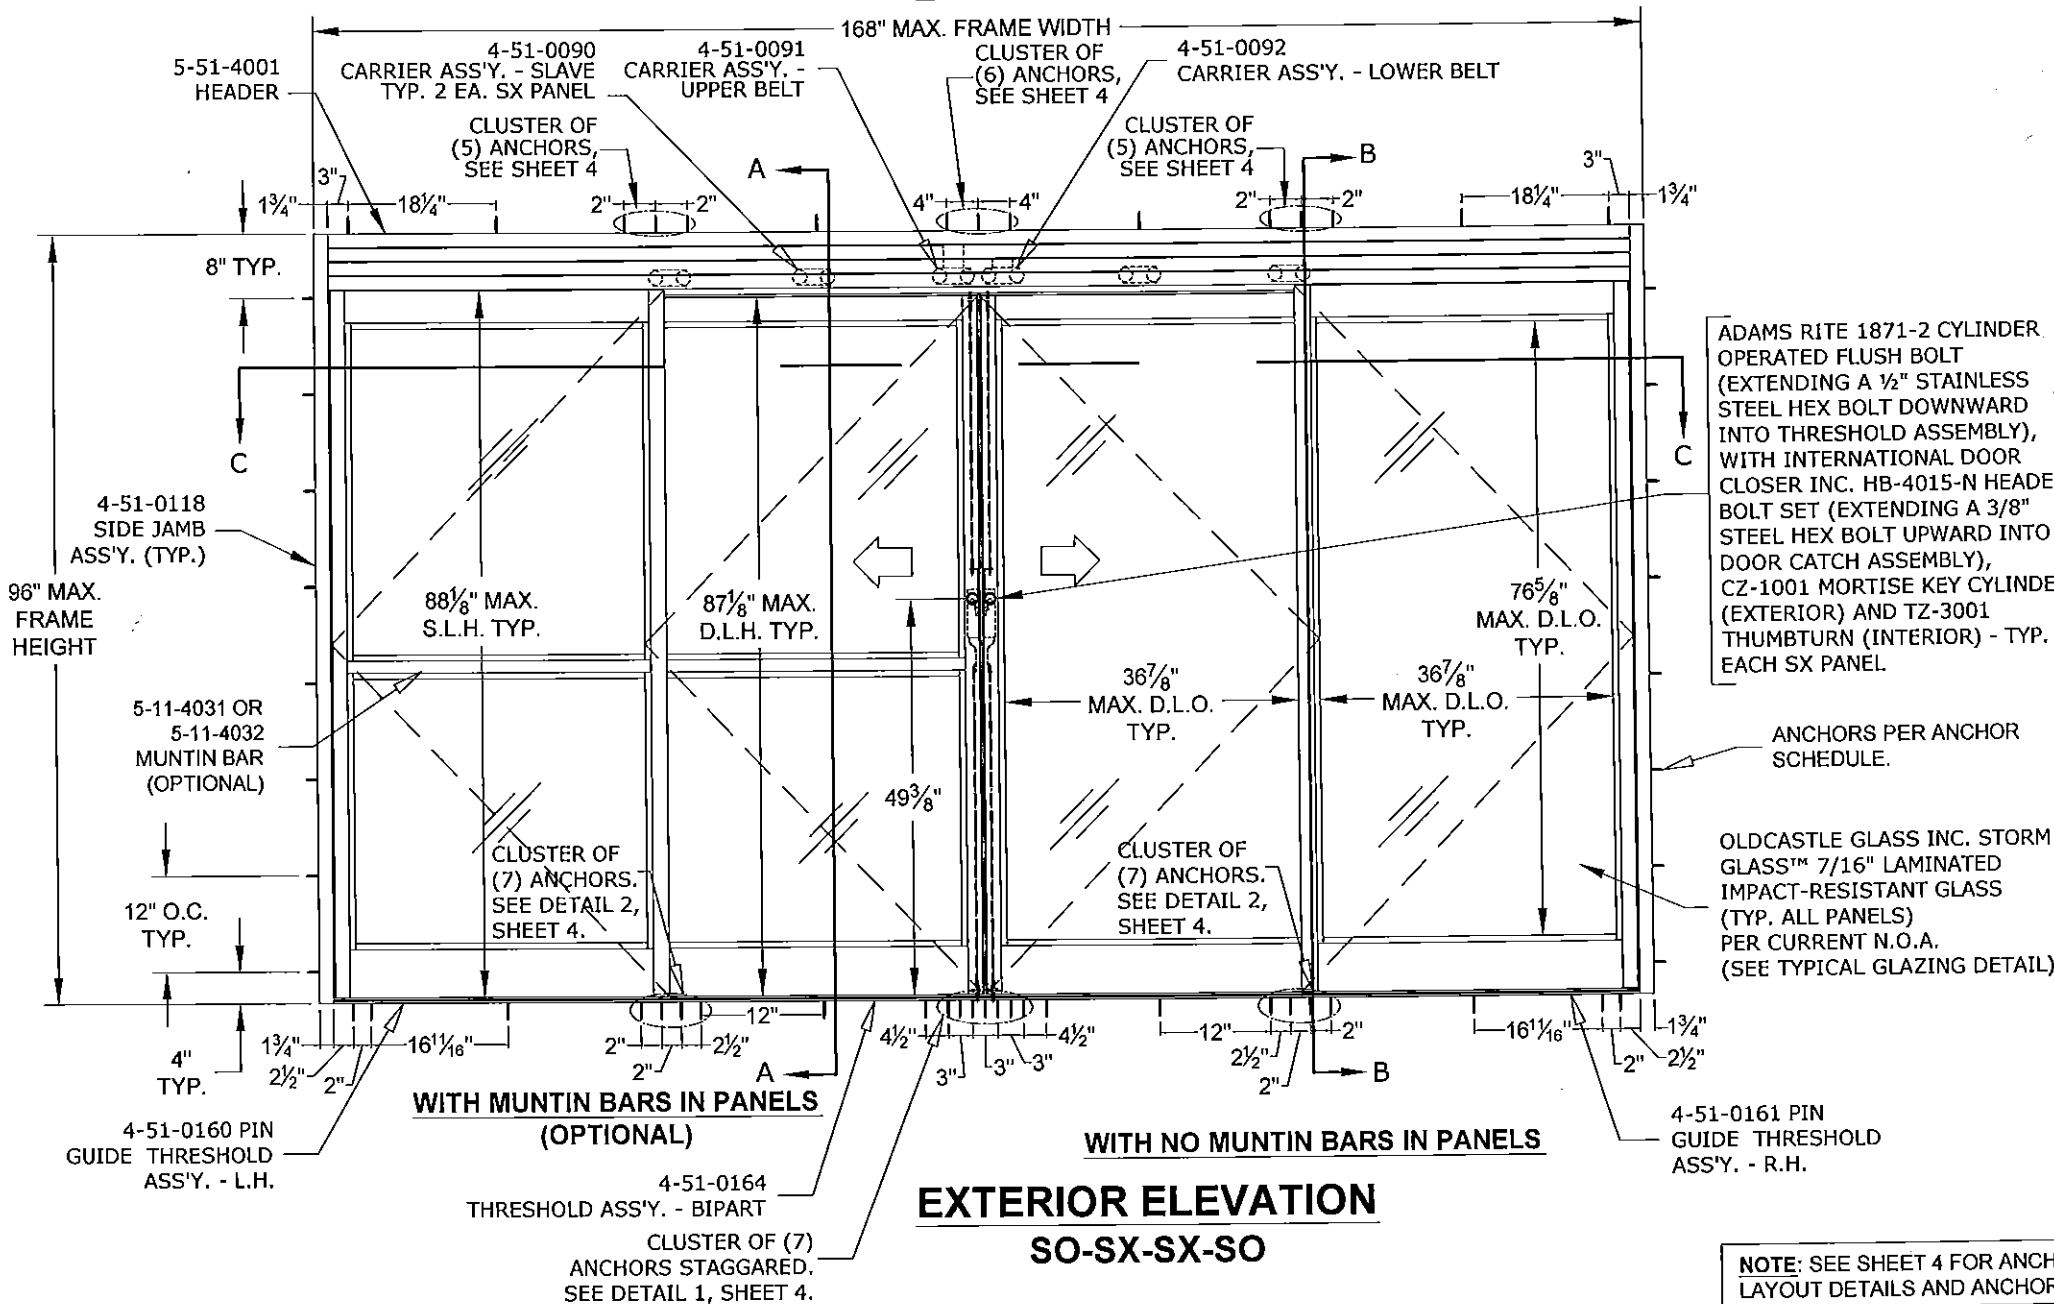

ADAMS RITE 1871-2 CYLINDER OPERATED FLUSH BOLT (EXTENDING A 1/2" STAINLESS STEEL HEX BOLT DOWNWARD INTO THRESHOLD ASSEMBLY), WITH INTERNATIONAL DOOR CLOSER INC. HB-4015-N HEADER BOLT SET (EXTENDING A 3/8" STEEL HEX BOLT UPWARD INTO DOOR CATCH ASSEMBLY), CZ-1001 MORTISE KEY CYLINDER (EXTERIOR) AND TZ-3001 THUMBTURN (INTERIOR) - TYP. EACH SX PANEL.

OLDCASTLE GLASS INC. STORM GLASS™ 7/16" LAMINATED IMPACT-RESISTANT GLASS (TYP. ALL PANELS) PER CURRENT N.O.A. (SEE TYPICAL GLAZING DETAIL)

NOTE: SEE SHEET 4 FOR ANCHOR LAYOUT DETAILS AND ANCHOR TYPES.

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212

SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE



REMARKS	DRWN	CHKD	DATE
INIT ISSUE	AML	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-REU-0001)	KL	FLB	03/19/12
REV FBC 2014	FRWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT THE WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. ANY REVISIONS, ADDITIONS, HIGHLIGHTING OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
 SCALE: -
 PAGE DESCRIPTION:
 PRODUCT REVIEWED as complying with the Florida Building Code Acceptance No. 15-0316.04 Expiration Date MAR 17, 2020
 By *Lehua J. Hunt*
 Miami Dade Product Control


V:\Projects\14-2163 NDA-Update 12-0403.06 (09-REU-0001) for 2014 FBC-Renewal\WP14-2163a_09-REU-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg
 02/11/2015 - 11:23am rickn

V:\Projects\14-2163 NOA-Update 12-0403.06 (09-REU-001) for 2014 FBC-Renewal\WP14-2163a_09-REU-001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg 02/11/2015 - 11:23am rickn

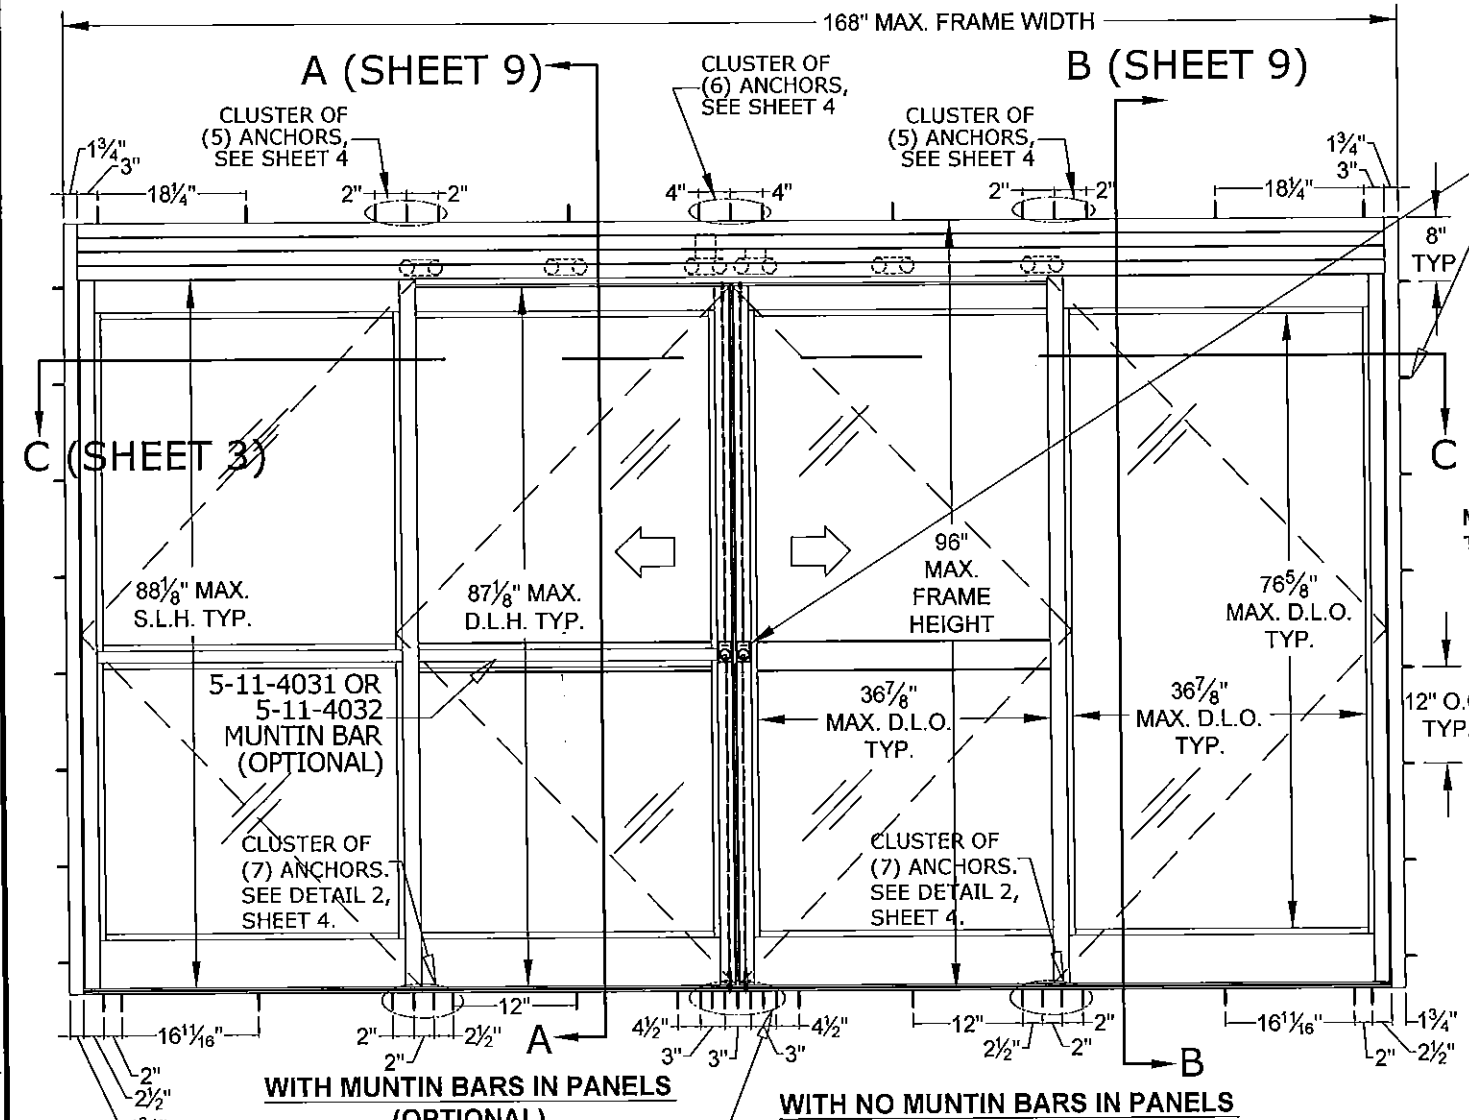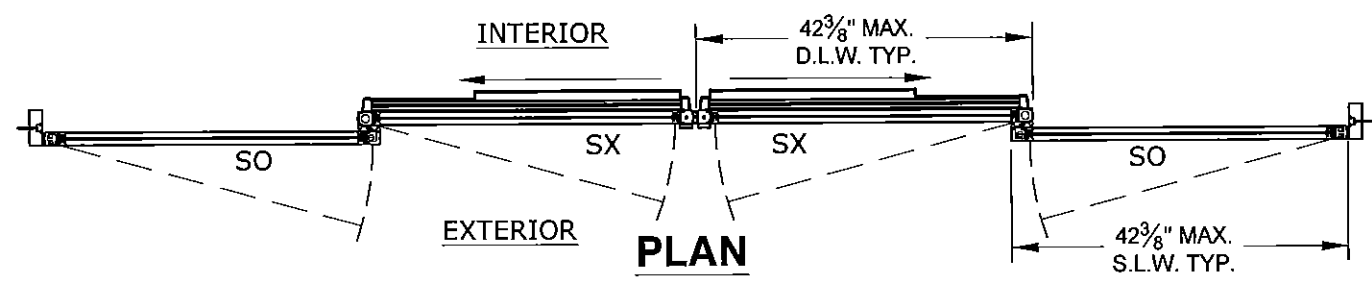

EXTERIOR ELEVATION
SO-SX-SX-SO

DESIGN PRESSURE RATING		IMPACT RATING
POSITIVE	+65 PSF	LARGE AND SMALL MISSILE IMPACT
NEGATIVE	-70 PSF	
NOTE: THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE THE WATER REQUIREMENT IS NOT NEEDED.		

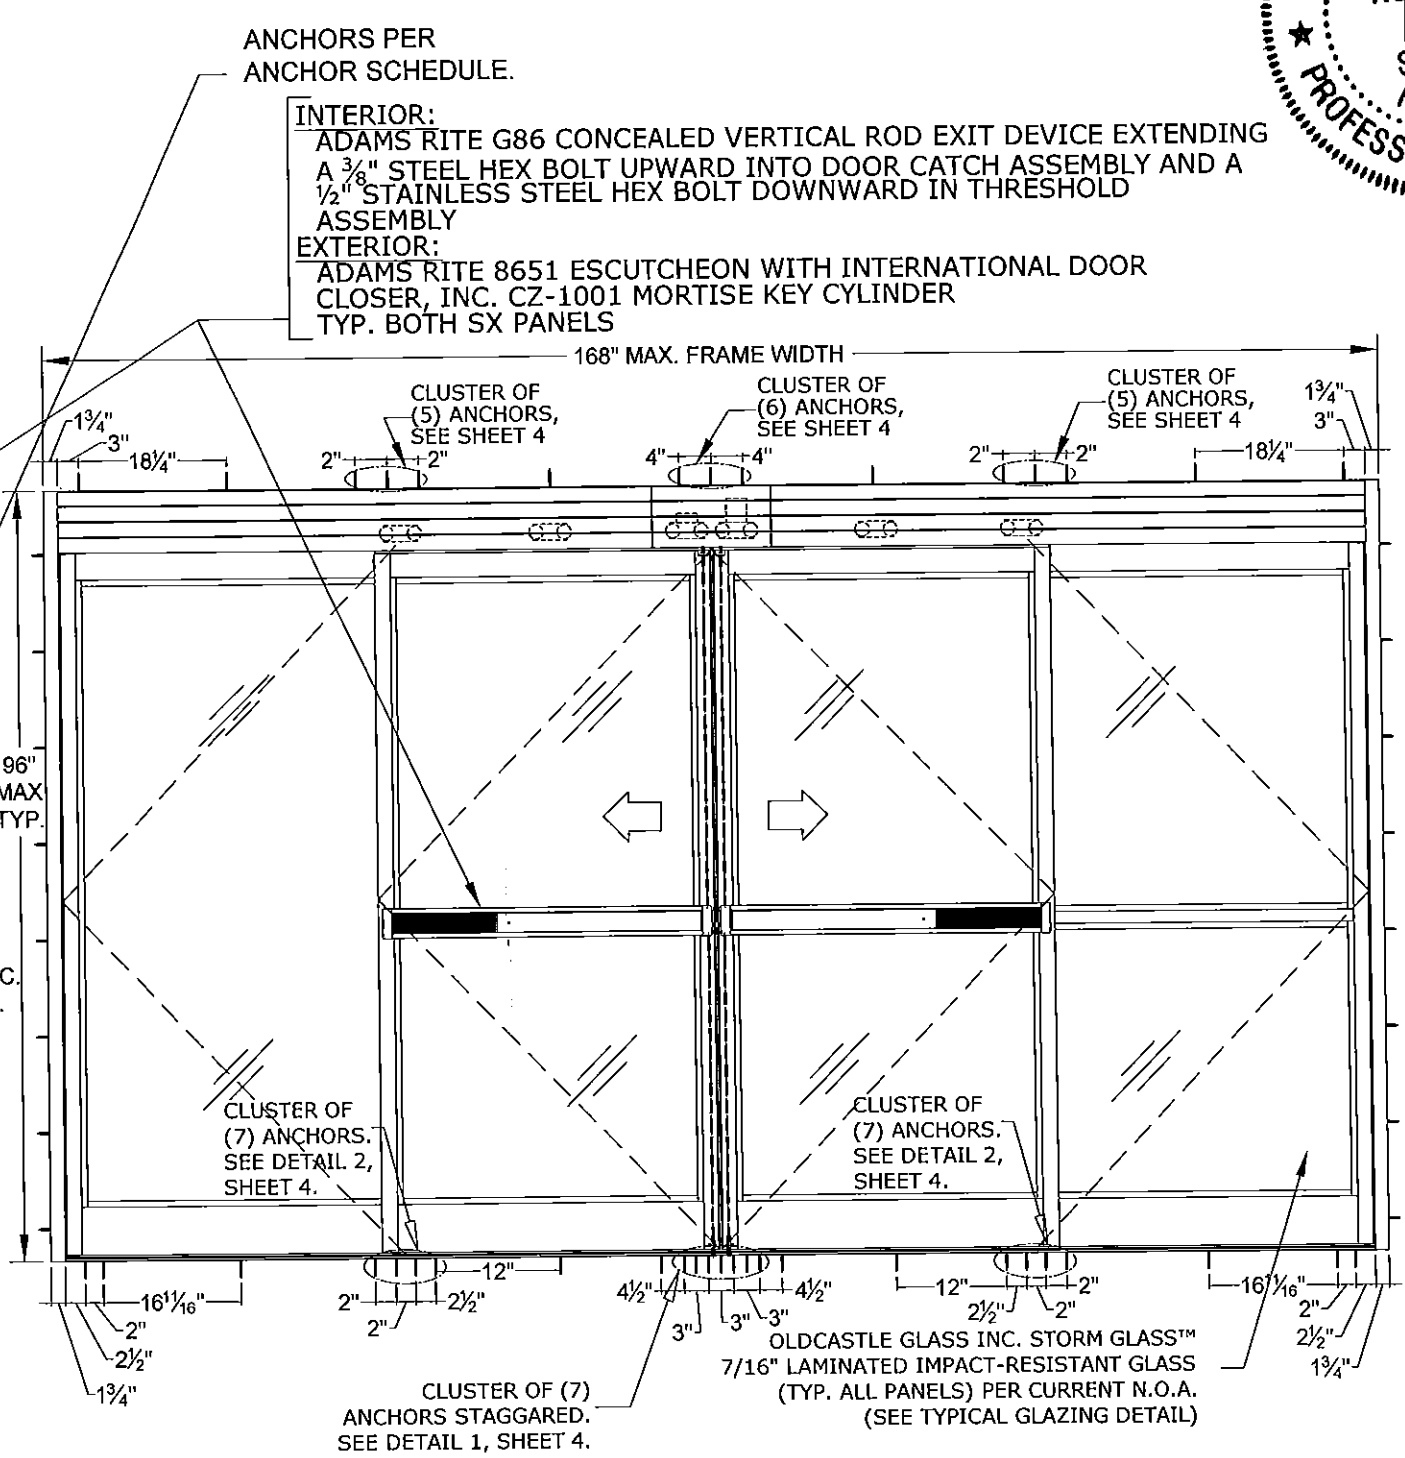

INTERIOR ELEVATION
SO-SX-SX-SO

NOTE: SEE SHEET 4 FOR ANCHOR LAYOUT DETAILS AND ANCHOR TYPES.

ANCHORS PER ANCHOR SCHEDULE.

INTERIOR:
ADAMS RITE G86 CONCEALED VERTICAL ROD EXIT DEVICE EXTENDING A 3/8\"/>

EXTERIOR:
ADAMS RITE 8651 ESCUTCHEON WITH INTERNATIONAL DOOR CLOSER, INC. CZ-1001 MORTISE KEY CYLINDER TYP. BOTH SX PANELS

FRANK L. BERNARDO, P.E.
LICENSE 02/11/2015
No. 46549

FRANK L. BERNARDO
ENGINEERING EXPRESS, INC.
160 SW 12th AVE, STE 106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 FAX: (954) 354-0661
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BERNARDO, P.E., INC. INNOVATION

RECORD-USA
4324 HARGETT COURT
MONROE, NC 28110
(704) 289 - 9212

SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT. ISSUE	AML	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-REU-001)	KL	FLB	03/19/12
REV FBC 2014	RWN	CSL	02/09/15


THIS DOCUMENT IS THE PROPERTY OF FRANK L. BERNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN CONSENT OF FRANK L. BERNARDO, P.E. - ALTERATIONS, ADDITIONS, HIGH LIGHTING OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 15-0316-04
Expiration Date 3/17/20

By: *[Signature]*
Miami Dade Product Control

14-2163
SCALE: -
PAGE DESCRIPTION:


02/11/2015 - 11:23am rickn
 V:\Projects\14-2163 NOA-Update 12-0403.06 (09-REU-0001) for 2014.FBC-Renewal\WP\14-2163a_09-REU-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg

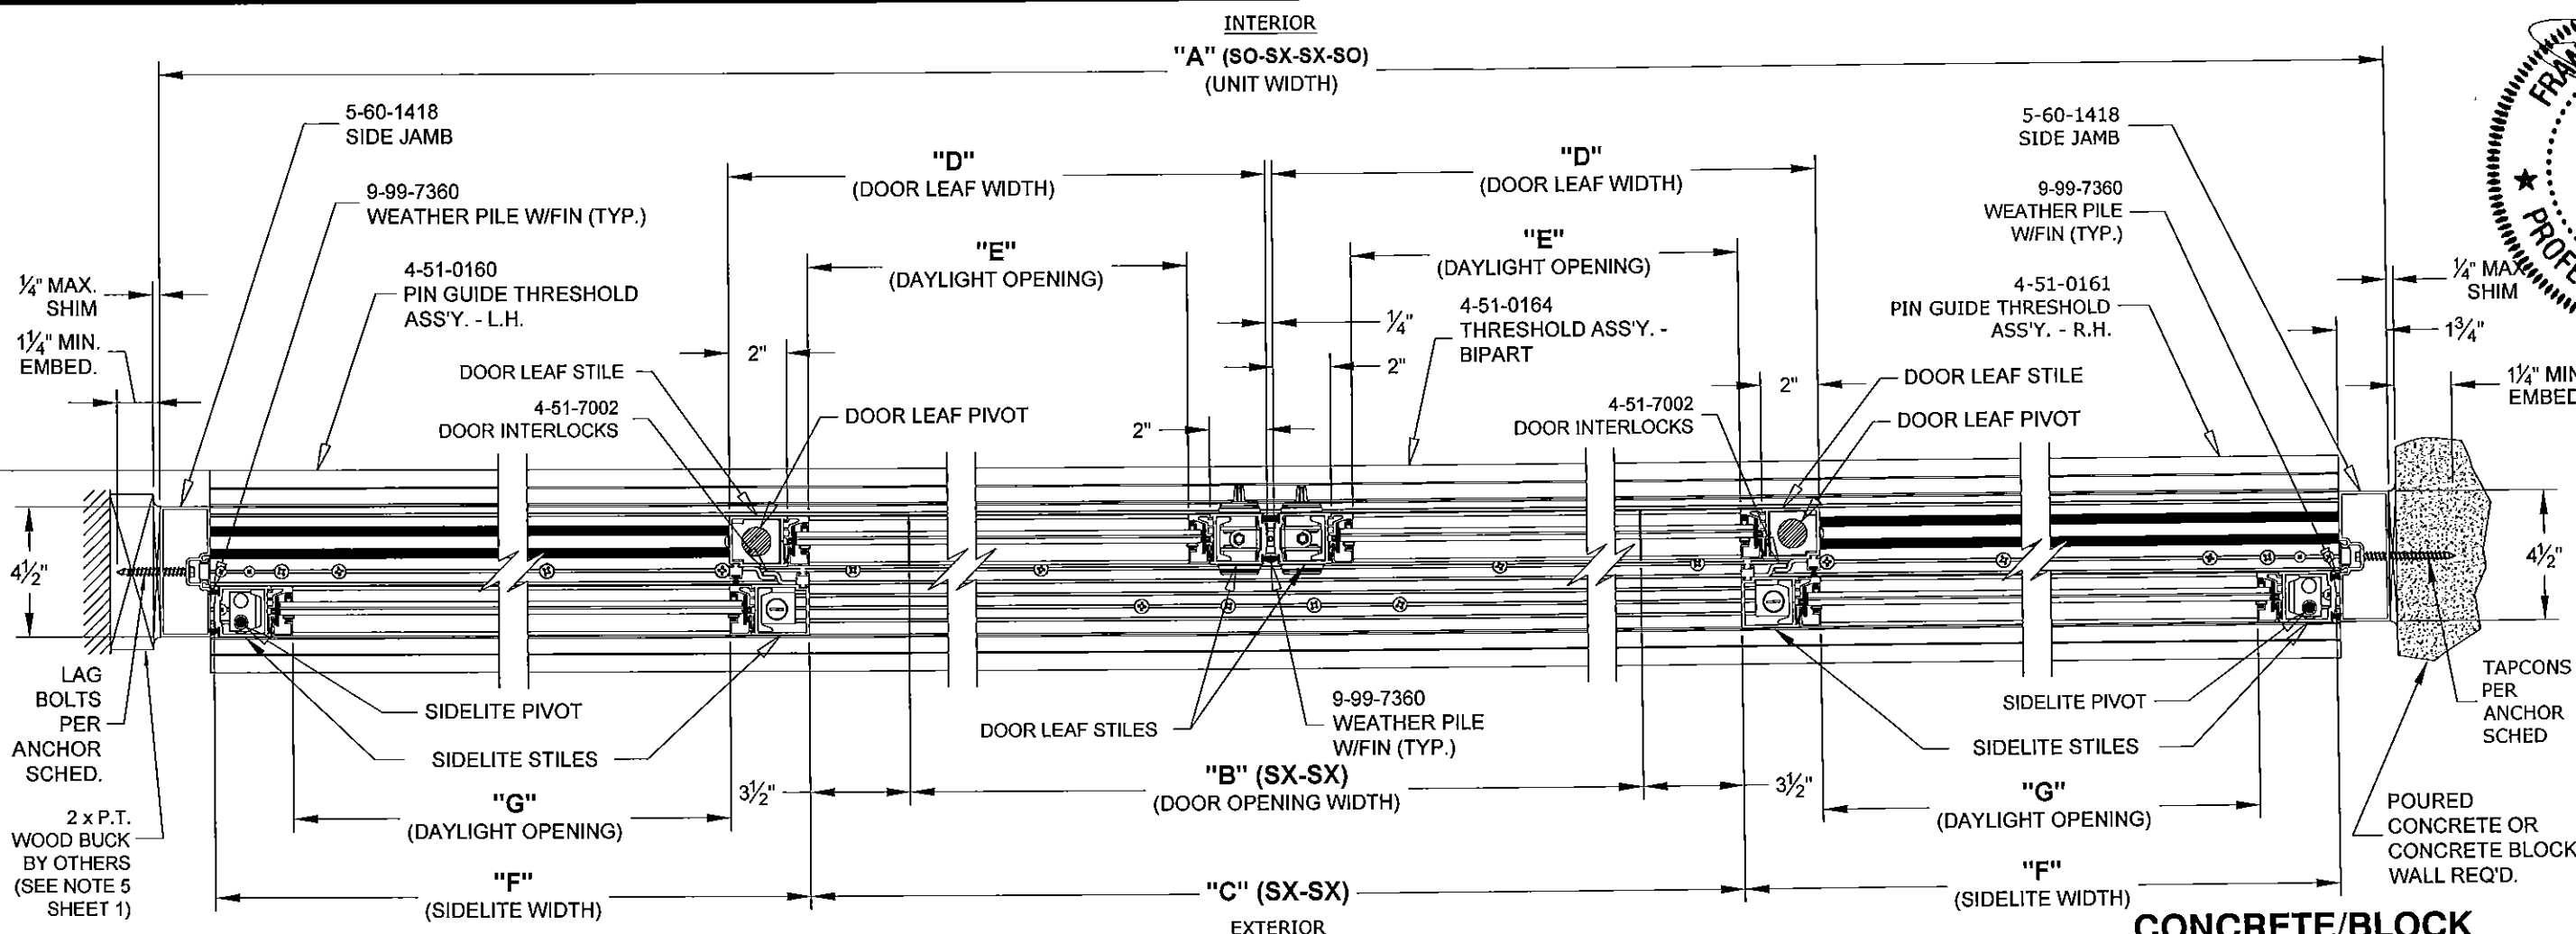

WOOD BUCK ALTERNATIVE

SECTION C-C

CONCRETE/BLOCK ALTERNATIVE

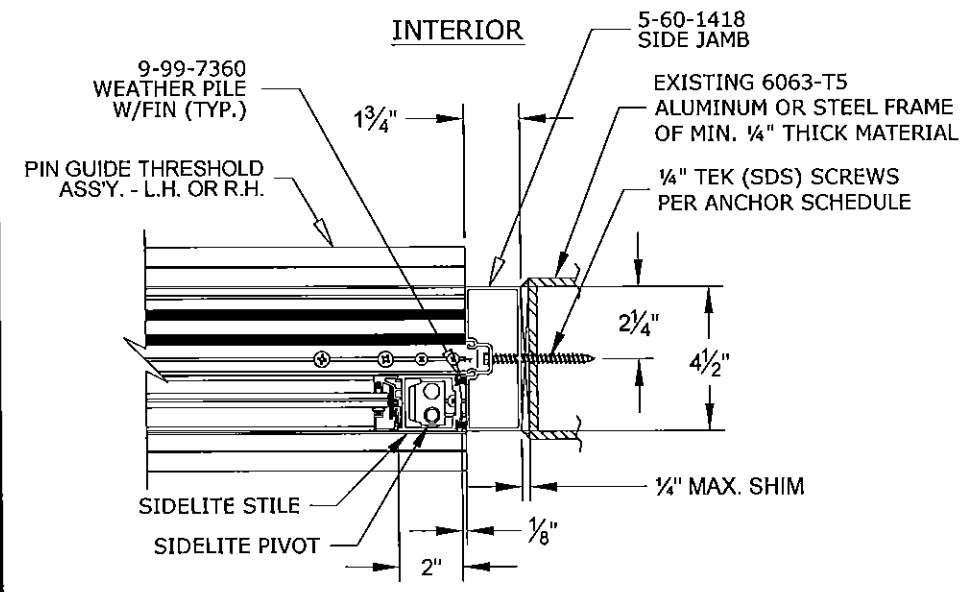

METAL STRUCTURE ALTERNATIVE

UNIT WIDTH "A" (SO-SX-SX-SO)	DOOR OPENING WIDTH "B" (SX-SX)	DIMENSION "C" (SX-SX)	DOOR LEAF SIZE		DAYLIGHT OPENING (DOOR LEAF)		SIDELITE SIZE		DAYLIGHT OPENING (SIDELITE)		UNIT HEIGHT (MAX.)	ROUGH OPENING WIDTH (INCL. 1/4" SHIM SPACE BOTH SIDES) (SO-SX-SX-SO)
			WIDTH "D"	HEIGHT	WIDTH "E"	HEIGHT	WIDTH "F"	HEIGHT	WIDTH "G"	HEIGHT		
9' 0"	42 1/2"	49 1/2"	27 3/8"	87 7/8"	21 7/8"	76 5/8"	27 3/8"	88 1/8"	21 7/8"	76 5/8"	8' 0"	9' 1/2"
10' 0"	48 1/2"	55 1/2"	30 3/8"	87 7/8"	24 7/8"	76 5/8"	30 3/8"	88 1/8"	24 7/8"	76 5/8"	8' 0"	10' 1/2"
12' 0"	60 1/2"	67 1/2"	36 3/8"	87 7/8"	30 7/8"	76 5/8"	36 3/8"	88 1/8"	30 7/8"	76 5/8"	8' 0"	12' 1/2"
14' 0"	72 1/2"	79 1/2"	42 3/8"	87 7/8"	36 1/8"	76 5/8"	42 3/8"	88 1/8"	36 1/8"	76 5/8"	8' 0"	14' 1/2"

NOTE: DOOR WIDTH AND HEIGHT SHALL COMPLY WITH THE MINIMUM REQUIREMENTS OF THE FLORIDA BUILDING CODE.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 15-0316.04
 Expiration Date 3/17/20
 By Chas. L. Hande
 Miami Dade Product Control

FRANK L. BENNARDO, P.E.
 PROFESSIONAL ENGINEER
 No. 46549
 ENGINEERING
 EXPERTISE
 160 SW 12th AVENUE, SUITE 200
 DEERFIELD BEACH, FL 33442
 PH: (954) 354-0660 FAX: (954) 354-0443
 WWW.ENGINEERING.COM/WEER
 CERT. OF AUTH. #6886
 A FRANK L. BENNARDO, P.E., INC. INNOVATION


RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212
SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INT ISSUE	AVL	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-REU-0001)	KL	FLB	03/19/12
REV FBC 2014	RWN	CSL	02/09/15


THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. - ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
 SCALE: _____
 PAGE DESCRIPTION: _____
 23

V:\Projects\14-2163 NOA-Update 12-0403.06 (09-REU-0001) for 2014 FBC-Renewal\WP14-2163a_09-REU-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg
 02/12/2015 - 10:05am nckn

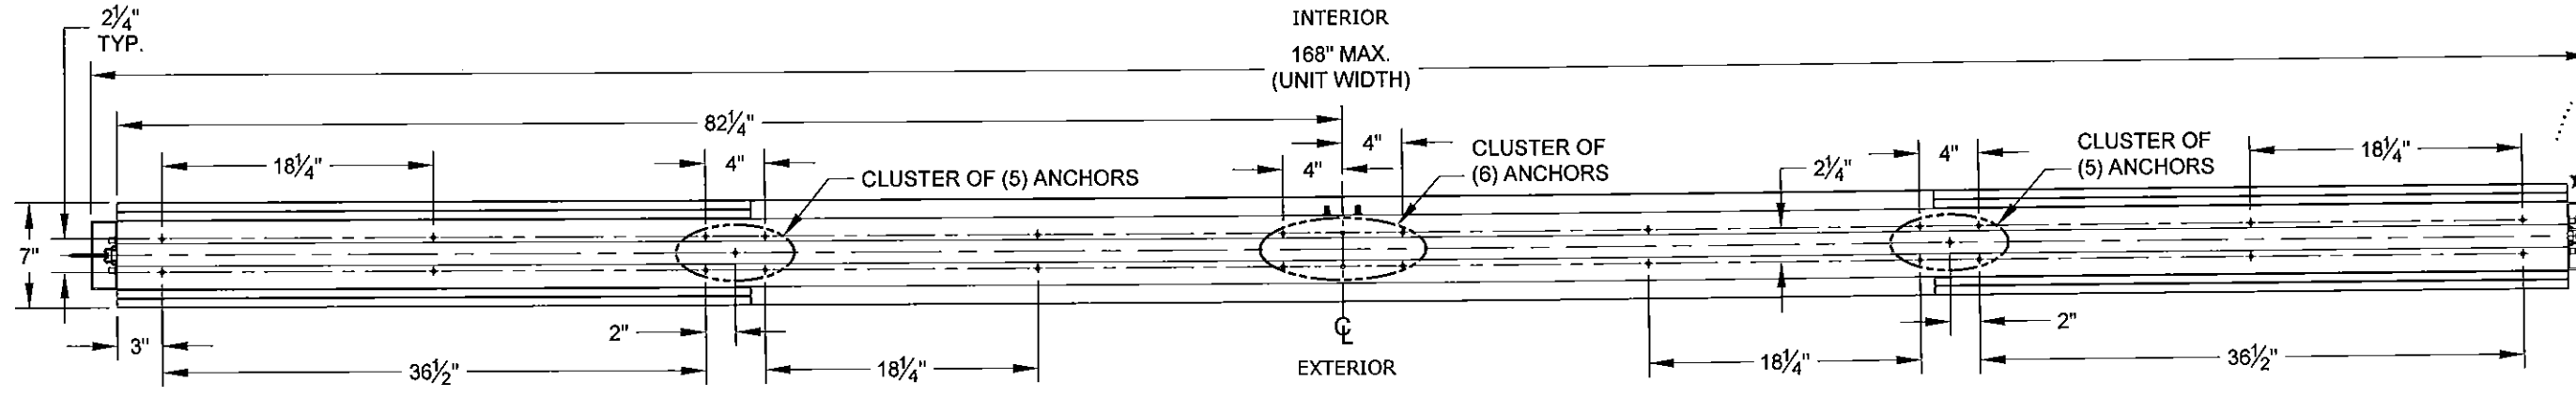

**ANCHOR LAYOUT AT HEADER
(SO-SX-SX-SO)**

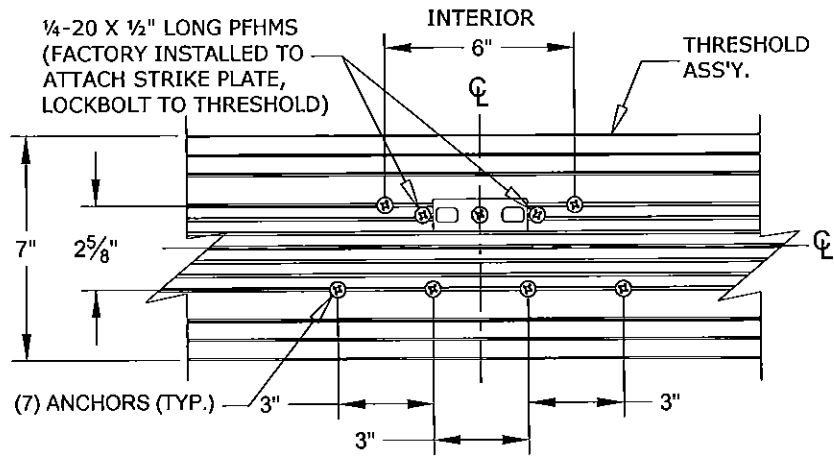


DETAIL 1

ANCHOR SCHEDULE		
LOCATION	SUBSTRATE	ANCHOR TYPE
HEAD	CONCRETE (3192 PSI MIN) OR CONCRETE BLOCK	1/4" ITW S.S. TAPCONS W/ 1-1/4" MIN. EMBEDMENT AND 2-1/2" MIN. EDGE DISTANCE
	WOOD (G=0.55 MIN)	#14 WOOD SCREWS W/ 1-1/2" MIN. THREAD PENETRATION AND 1" MIN. EDGE DISTANCE
	1/4" MINIMUM 6063-T5 ALUMINUM OR STEEL	1/4" 316 STAINLESS STEEL SELF DRILLING SCREWS W/ 1/2" MIN. EDGE DISTANCE
JAMBS	CONCRETE (3192 PSI MIN) OR CONCRETE BLOCK	1/4" ITW S.S. TAPCONS W/ 1-1/4" MIN. EMBEDMENT AND 2-1/2" MIN. EDGE DISTANCE
	WOOD (G=0.55 MIN)	#14 WOOD SCREWS W/ 1-1/2" MIN. THREAD PENETRATION AND 1" MIN. EDGE DISTANCE
	1/4" MINIMUM 6063-T5 ALUMINUM OR STEEL	1/4" 316 STAINLESS STEEL SELF DRILLING SCREWS W/ 1/2" MIN. EDGE DISTANCE
SILL	CONCRETE (3192 PSI MIN) OR CONCRETE BLOCK	1/4" ITW S.S. TAPCONS W/ 1-1/2" MIN. EMBEDMENT AND 2-1/2" MIN. EDGE DISTANCE
	WOOD (G=0.55 MIN)	1/4" S.S. ITW TAPCONS W/ 1-1/2" MIN. THREAD PENETRATION AND 3/4" MIN. EDGE DISTANCE
	1/4" MINIMUM 6063-T5 ALUMINUM OR STEEL	1/4" 316 STAINLESS STEEL SELF DRILLING SCREWS W/ 1/2" MIN. EDGE DISTANCE


ANCHOR NOTES:

- SEE EXTERIOR ELEVATIONS AND ANCHOR LAYOUT DETAILS FOR ANCHOR LOCATIONS AND/OR SPACING.
- ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS. ALL CONCRETE ANCHORS SHALL BE INSTALLED TO NON-CRACKED CONCRETE ONLY.
- ENSURE MINIMUM 2-1/2" EDGE DISTANCE FOR ALL ANCHORS TO CONCRETE & TO CONCRETE BLOCK. EDGE DISTANCE OF 1/2" IS ACCEPTABLE FOR ANCHORS TO STEEL OR ALUMINUM.
- WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD, U.N.O..
- WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
- ANCHOR REQUIREMENTS AS SHOWN HEREIN, INCLUDING MINIMUM EMBEDMENT AND EDGE DISTANCE, EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN WITHIN THE HVHZ, A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE SHALL BE APPLIED FOR AND SECURED FROM THE MIAMI-DADE BUILDING CODE COMPLIANCE OFFICE PRODUCT CONTROL DIVISION. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN OUTSIDE THE HVHZ, THE BUILDING OFFICIAL MAY REQUIRE A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE BE OBTAINED, OR THAT SITE SPECIFIC DOCUMENTS BE PREPARED, SIGNED, DATED AND SEALED BY A LICENSED ENGINEER OR REGISTERED ARCHITECT, WHICH DETAIL AND JUSTIFY THE DEVIATION.
- WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
- WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
- SELF DRILLING SCREWS SHALL BE SAE GRADE 5 INSTALLED WITH FULL ENGAGEMENT OF THREADS INTO METAL HOST STRUCTURE AND MAY HAVE EITHER A FLAT HEAD, PAN HEAD, TRUSS HEAD, OR OTHER HEAD STYLES. PROVIDE (5) PITCHES MIN. PAST THE THREAD PLANE.

NOTE: FOR SO-SX OR SX-SO ANCHOR LAYOUTS, SEE SHEET 8.

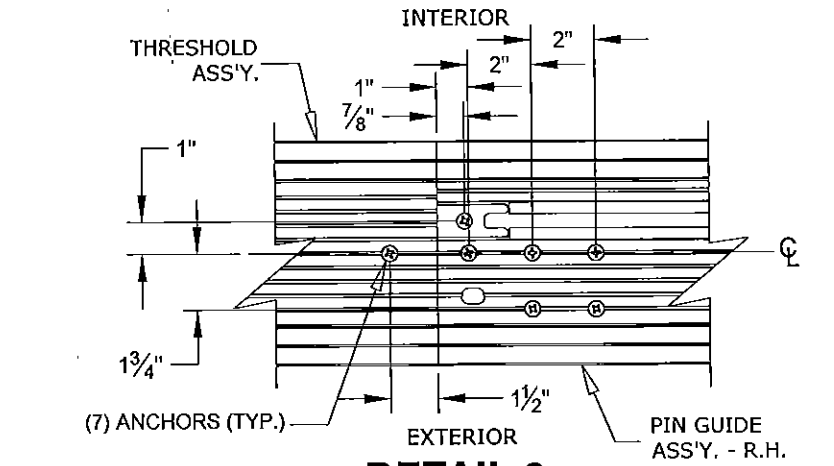

DETAIL 2

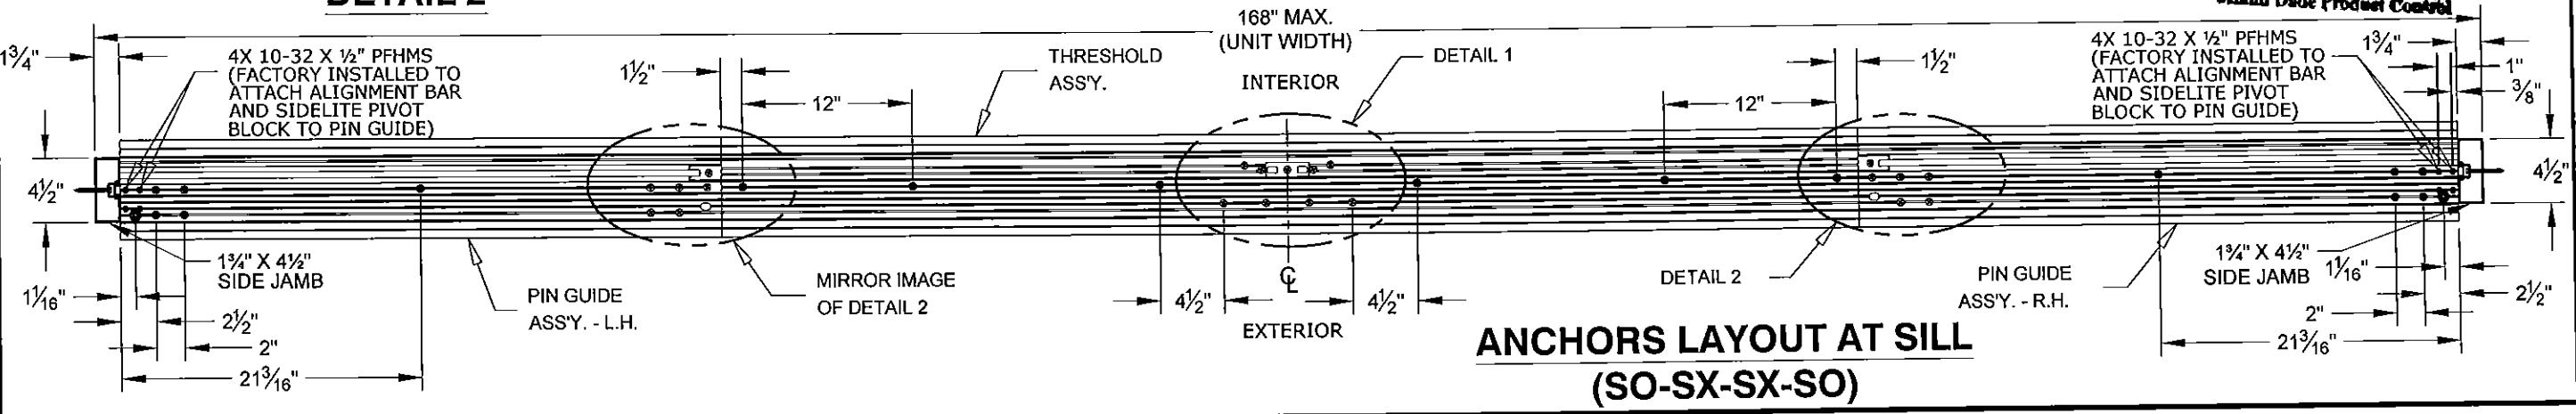

**ANCHORS LAYOUT AT SILL
(SO-SX-SX-SO)**

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 15-0316.04
 Expiration Date 3/17/20
 By [Signature]
 Miami Dade Product Control



FRANK L. BENNARDO, P.E.
 #PE0046549
 LICENSE
 No. 46549
 PROFESSIONAL ENGINEER
 ENGINEERING EXPERTISE
 160 SW 12th Avenue, #106
 DEERFIELD BEACH, FL 33442
 Ph: (954) 354-0660 FAX: (954) 591-0443
 WWW.ENGEXP.COM
 CERT. OF AUTH. #8885
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212
 SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

DRWN	CHKD	DATE
AVL	KL	06/26/09
INT	FLB	12/01/09
REV PER BCCO COMMENT	KL	03/19/12
2010 FBC (09-REU-0001)	RWN	02/09/15
REV FBC 2014		

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. - ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
 SCALE:
 PAGE DESCRIPTION:
 23
4

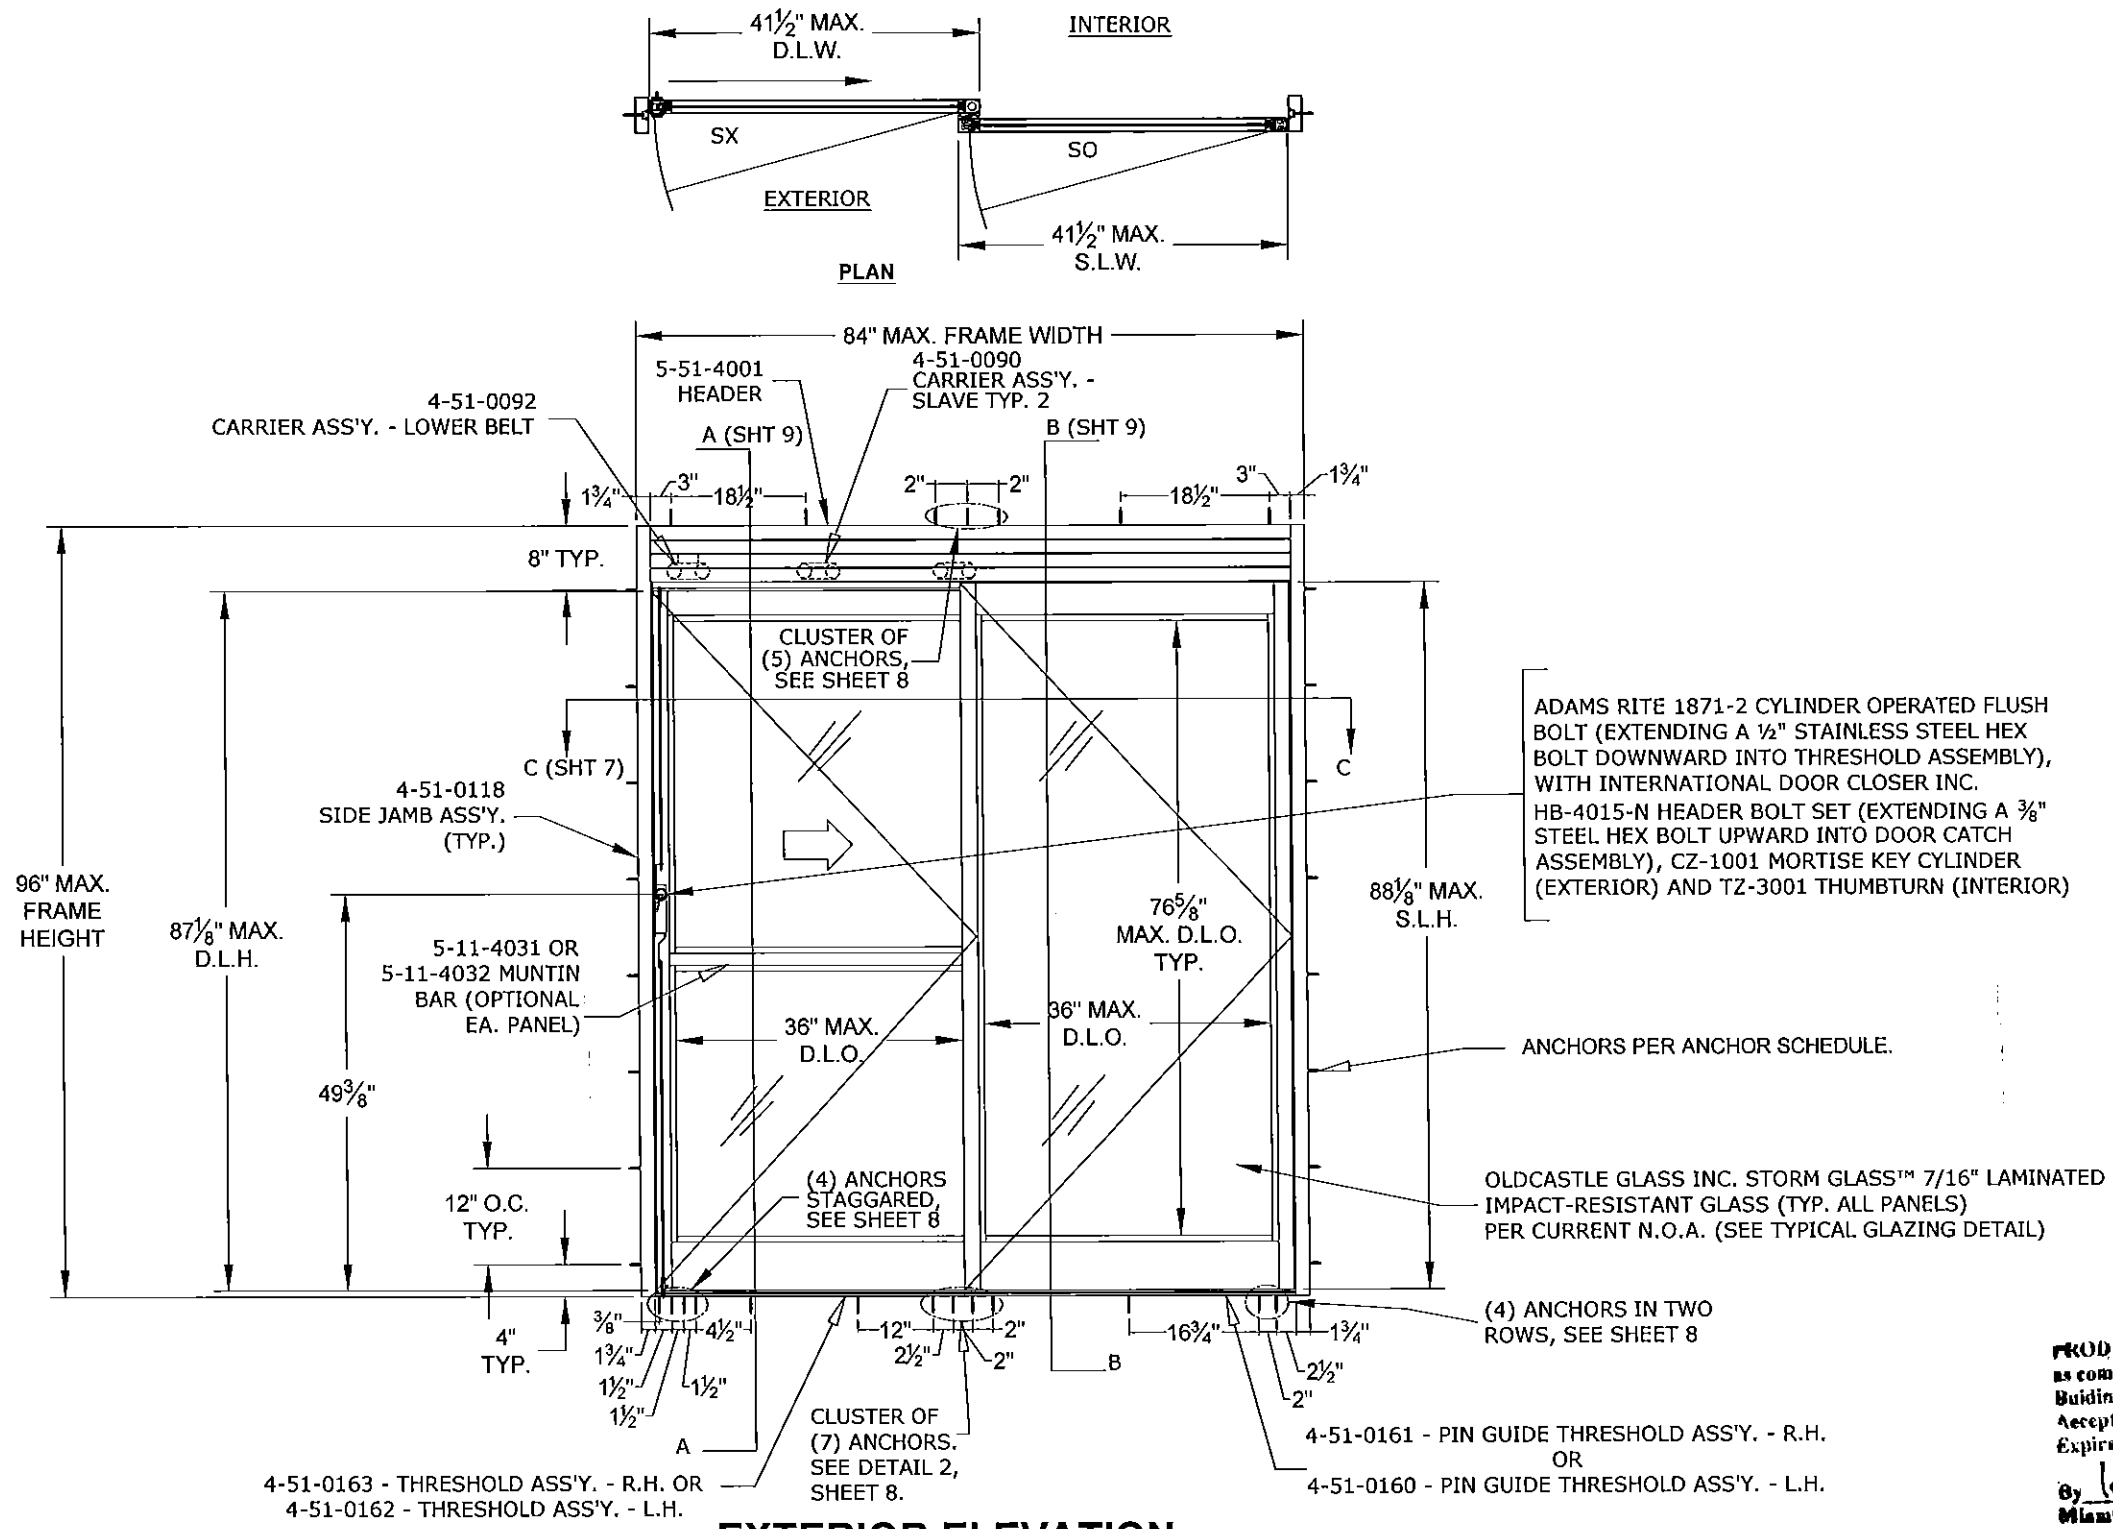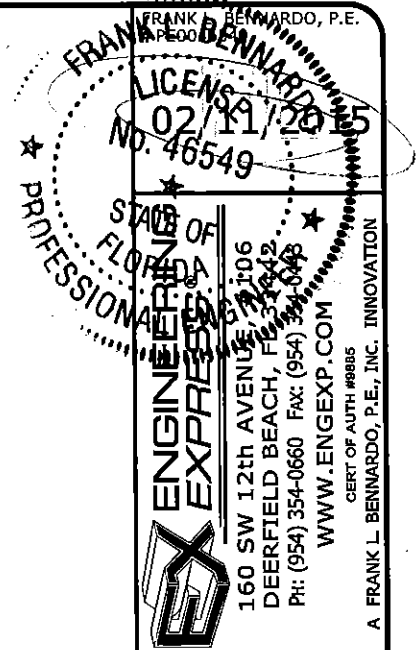

ADAMS RITE 1871-2 CYLINDER OPERATED FLUSH BOLT (EXTENDING A 1/2" STAINLESS STEEL HEX BOLT DOWNWARD INTO THRESHOLD ASSEMBLY), WITH INTERNATIONAL DOOR CLOSER INC. HB-4015-N HEADER BOLT SET (EXTENDING A 3/8" STEEL HEX BOLT UPWARD INTO DOOR CATCH ASSEMBLY), CZ-1001 MORTISE KEY CYLINDER (EXTERIOR) AND TZ-3001 THUMBTURN (INTERIOR)

ANCHORS PER ANCHOR SCHEDULE.

OLDCASTLE GLASS INC. STORM GLASS™ 7/16" LAMINATED IMPACT-RESISTANT GLASS (TYP. ALL PANELS) PER CURRENT N.O.A. (SEE TYPICAL GLAZING DETAIL)

(4) ANCHORS IN TWO ROWS, SEE SHEET 8

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No. 15-0316.04
 Expiration Date 3/17/20
By: [Signature]
 Miami Dade Product Control

EXTERIOR ELEVATION
5405 SX-SO R.H. SHOWN
5404 SO-SX L.H. OPPOSITE

NOTE: SEE SHEET 8 FOR ANCHOR LAYOUT DETAILS AND ANCHOR TYPES.

DESIGN PRESSURE RATING		IMPACT RATING
POSITIVE	+65 PSF	LARGE AND SMALL MISSILE IMPACT
NEGATIVE	-70 PSF	
NOTE: THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE THE WATER REQUIREMENT IS NOT NEEDED.		

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212

SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	AML	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-REU-0001)	KL	FLB	03/19/12
REV FBC 2014	RWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENARDO, P.E. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
 SCALE:
 PAGE DESCRIPTION:
 5

V:\Projects\14-2163 NOA-Update 12-0403.06 (09-REU-0001) for 2014 FBC-Renewal\WP\14-2163a_09-REU-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg
 02/11/2015 - 11:24am rickn

V:\Projects\14-2163 NOA-Update 12-0403.06 (09-REL-0001) for 2014 FBC-Renewal\WP14-2163a_09-REL-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg

02/11/2015 - 11:24am rickn



FRANK L. BENNARDO, P.E.
 LICENSE NO. 46549
 PROFESSIONAL ENGINEER
 STATE OF FLORIDA
 ENGINEERING
 EXPRESS
 160 SW 12th Avenue, #106
 Deerfield Beach, FL 33442
 Ph: (954) 354-0660 Fax: (954) 354-0443
 WWW.ENGEXP.COM
 CERT. OF AUTH. #9895
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212

SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	INIT	ISSUE	DATE
2010 FBC (09-REL-0001)	KL	FLB	12/01/09
REV PER BCCO COMMENT	KL	FLB	03/19/12
REV FBC 2014	RWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. ALL REFERENCES TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

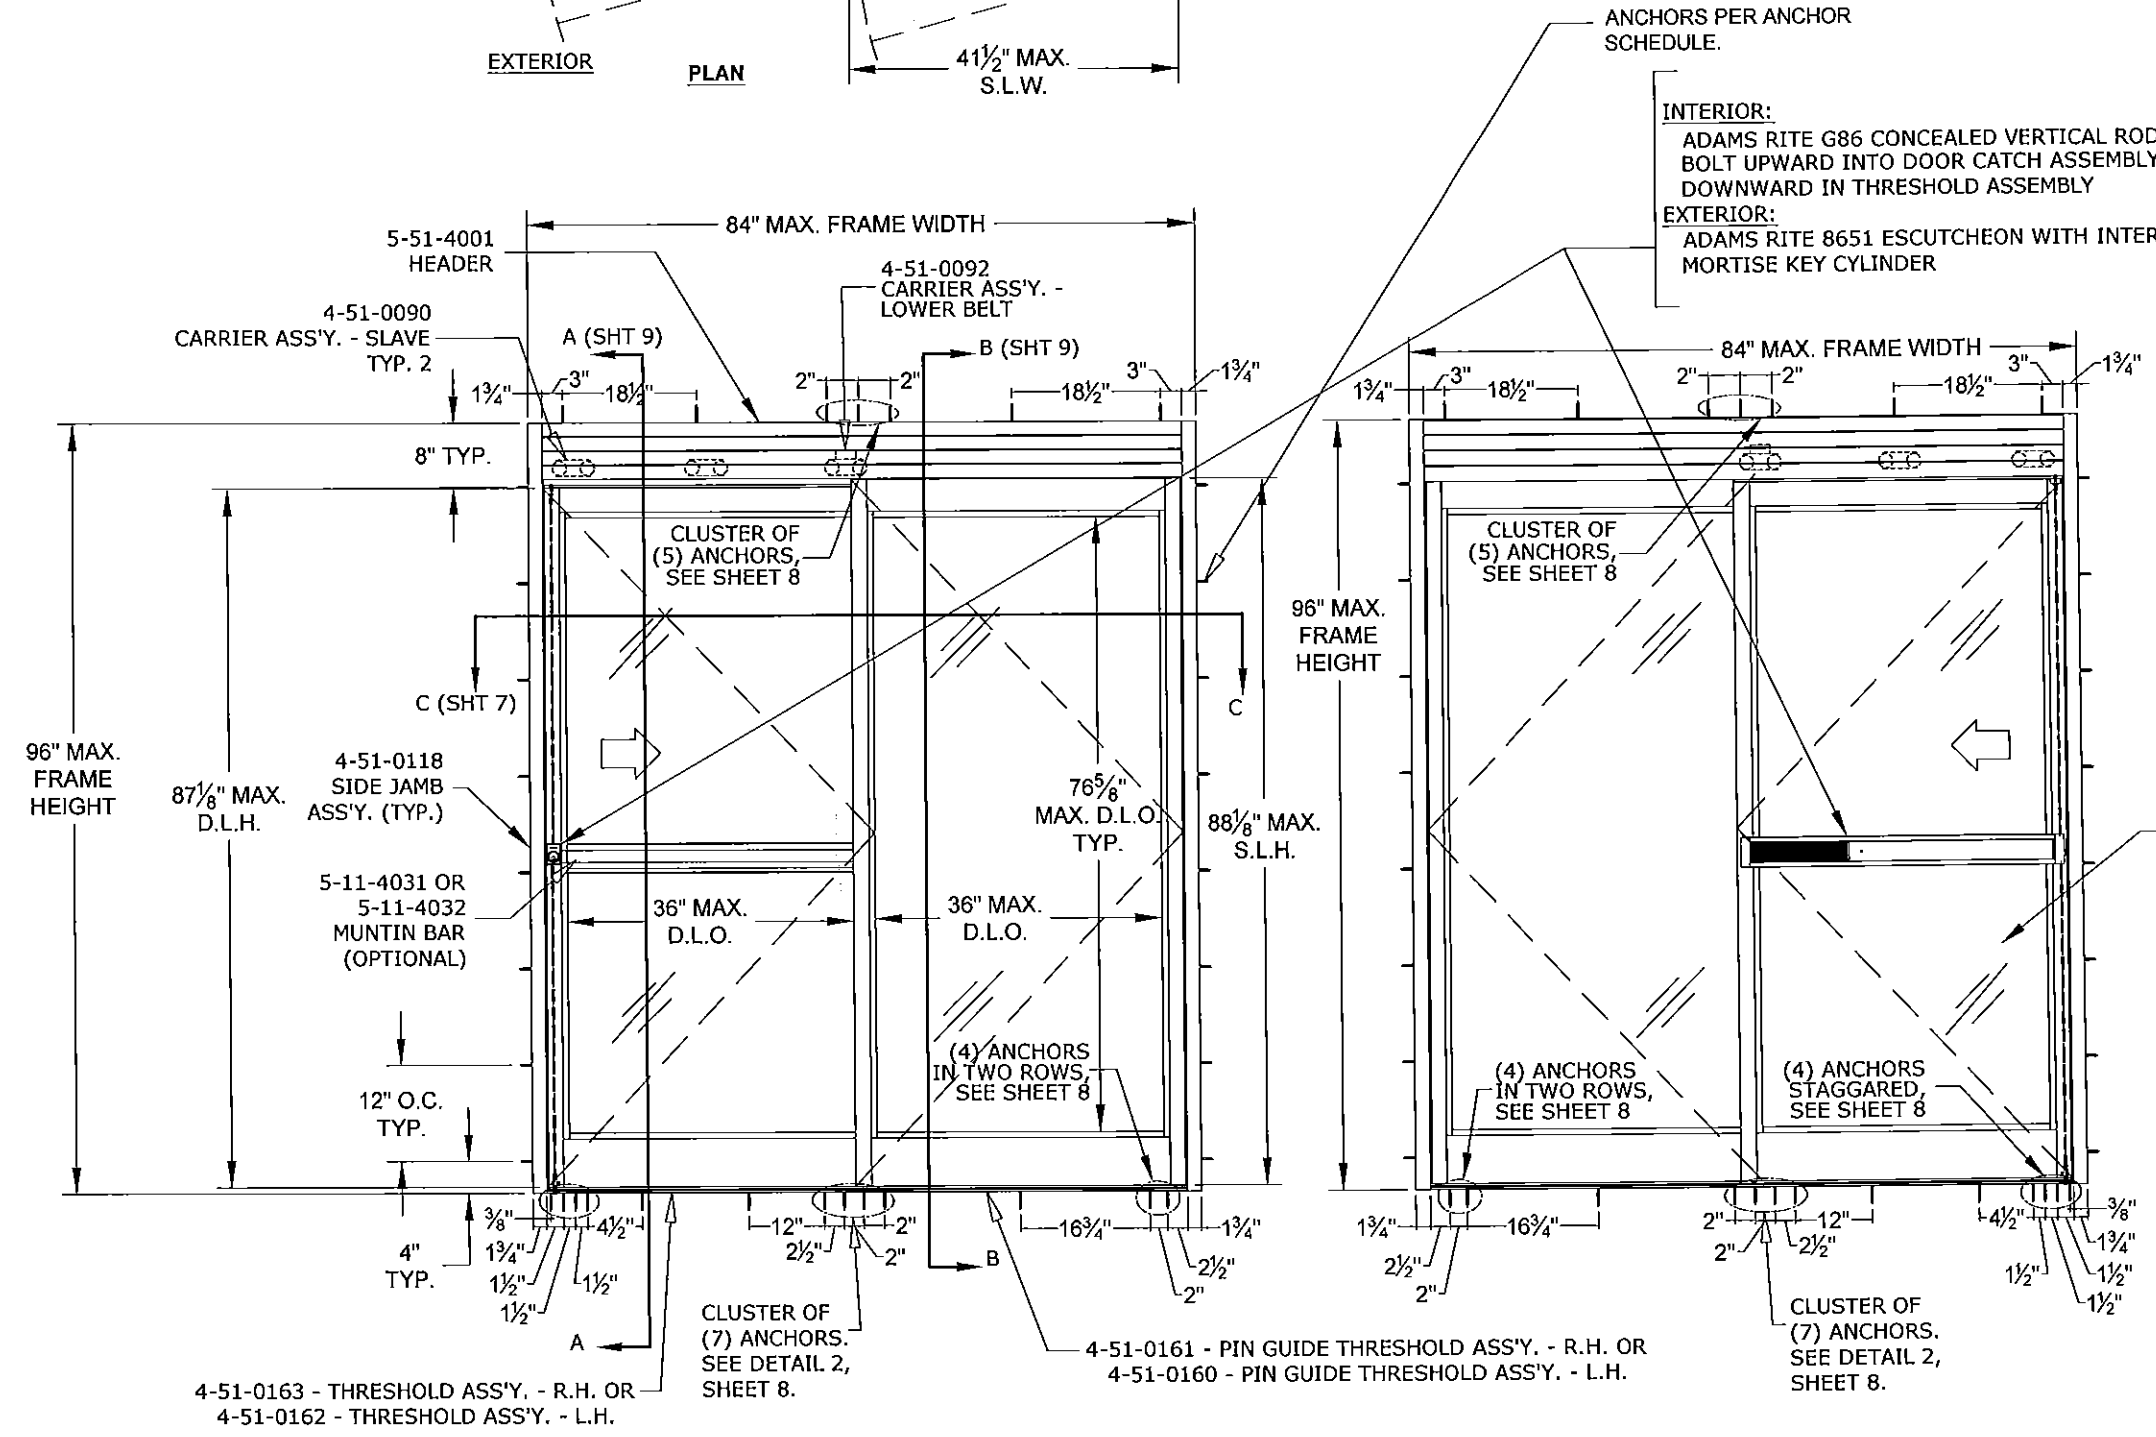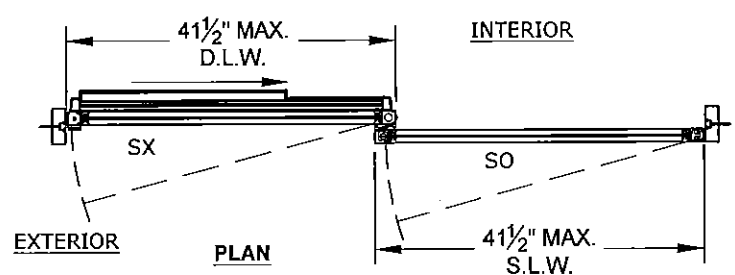

ANCHORS PER ANCHOR SCHEDULE.

INTERIOR:
 ADAMS RITE G86 CONCEALED VERTICAL ROD EXIT DEVICE EXTENDING A 3/8\"/>

EXTERIOR:
 ADAMS RITE 8651 ESCUTCHEON WITH INTERNATIONAL DOOR CLOSER, INC. CZ-1001 MORTISE KEY CYLINDER

OLDCASTLE GLASS INC. STORM GLASS™ 7/16\"/>

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No. 15-031604
 Expiration Date 3/17/20
 By: *Shay L. Chanda*
 Miami Dade Product Control

EXTERIOR ELEVATION
5405 SX-SO R.H. SHOWN
5404 SO-SX L.H. OPPOSITE


DESIGN PRESSURE RATING		IMPACT RATING
POSITIVE	+65 PSF	
NEGATIVE	-70 PSF	

NOTE: THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE THE WATER REQUIREMENT IS NOT NEEDED.

NOTE: SEE SHEET 8 FOR ANCHOR LAYOUT DETAILS AND ANCHOR TYPES.

14-2163
 SCALE:
 PAGE DESCRIPTION:
 23

02/12/2015 - 10:05am rickn V:\Projects\14-2163 NOA-Update 12-04-03.06 (09-REU-0001) for 2014 FBC-Renewal\WP14-2163a_09-REU-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg

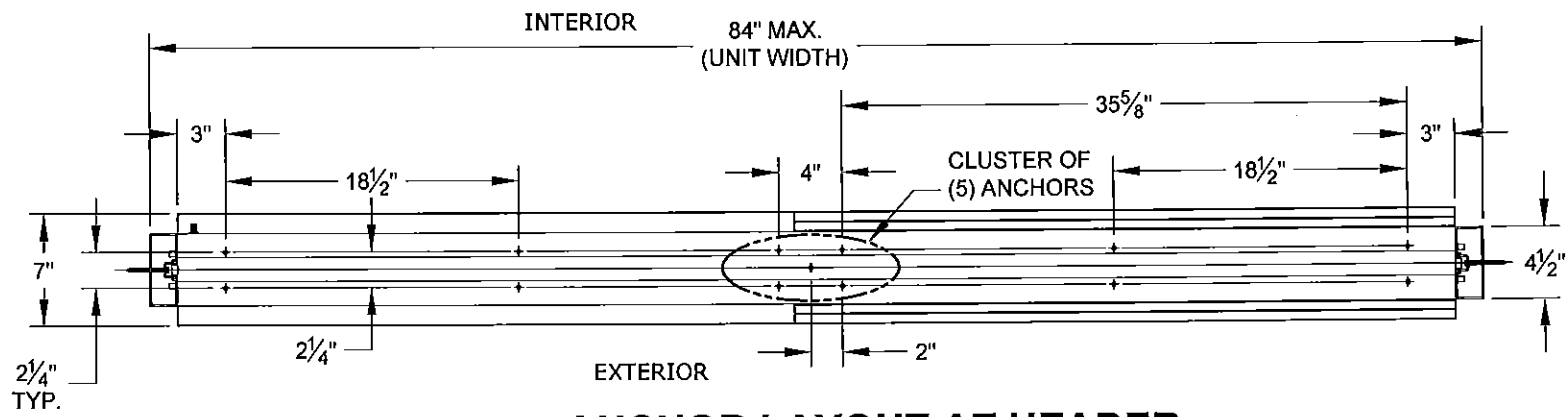


**ANCHOR LAYOUT AT HEADER
(TYP. FOR SO-SX OR SX-SO)**


ANCHOR SCHEDULE		
LOCATION	SUBSTRATE	ANCHOR TYPE
HEAD	CONCRETE (3192 PSI MIN) OR CONCRETE BLOCK	1/4" ITW S.S. TAPCONS W/ 1-1/4" MIN. EMBEDMENT AND 2-1/2" MIN. EDGE DISTANCE
	WOOD (G=0.55 MIN)	#14 WOOD SCREWS W/ 1-1/2" MIN. THREAD PENETRATION AND 1" MIN. EDGE DISTANCE
	1/4" MINIMUM 6063-T5 ALUMINUM OR STEEL	1/4" 316 STAINLESS STEEL SELF DRILLING SCREWS W/ 1/2" MIN. EDGE DISTANCE
JAMBS	CONCRETE (3192 PSI MIN) OR CONCRETE BLOCK	1/4" ITW S.S. TAPCONS W/ 1-1/4" MIN. EMBEDMENT AND 2-1/2" MIN. EDGE DISTANCE
	WOOD (G=0.55 MIN)	#14 WOOD SCREWS W/ 1-1/2" MIN. THREAD PENETRATION AND 1" MIN. EDGE DISTANCE
	1/4" MINIMUM 6063-T5 ALUMINUM OR STEEL	1/4" 316 STAINLESS STEEL SELF DRILLING SCREWS W/ 1/2" MIN. EDGE DISTANCE
SILL	CONCRETE (3192 PSI MIN) OR CONCRETE BLOCK	1/4" ITW S.S. TAPCONS W/ 1-1/2" MIN. EMBEDMENT AND 2-1/2" MIN. EDGE DISTANCE
	WOOD (G=0.55 MIN)	1/4" ITW S.S. TAPCONS W/ 1-1/2" MIN. THREAD PENETRATION AND 3/4" MIN. EDGE DISTANCE
	1/4" MINIMUM 6063-T5 ALUMINUM OR STEEL	1/4" 316 STAINLESS STEEL SELF DRILLING SCREWS W/ 1/2" MIN. EDGE DISTANCE

ANCHOR NOTES:


- SEE EXTERIOR ELEVATIONS AND ANCHOR LAYOUT DETAILS FOR ANCHOR LOCATIONS AND/OR SPACING.
- ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS. ALL CONCRETE ANCHORS SHALL BE INSTALLED TO NON-CRACKED CONCRETE ONLY.
- ENSURE MINIMUM 2-1/2" EDGE DISTANCE FOR ALL ANCHORS TO CONCRETE & TO CONCRETE BLOCK. EDGE DISTANCE OF 1/2" IS ACCEPTABLE FOR ANCHORS TO STEEL OR ALUMINUM.
- WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD, U.N.O..
- WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
- ANCHOR REQUIREMENTS AS SHOWN HEREIN, INCLUDING MINIMUM EMBEDMENT AND EDGE DISTANCE, EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN WITHIN THE HVHZ, A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE SHALL BE APPLIED FOR AND SECURED FROM THE MIAMI-DADE BUILDING CODE COMPLIANCE OFFICE PRODUCT CONTROL DIVISION. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN OUTSIDE THE HVHZ, THE BUILDING OFFICIAL MAY REQUIRE A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE BE OBTAINED, OR THAT SITE SPECIFIC DOCUMENTS BE PREPARED, SIGNED, DATED AND SEALED BY A LICENSED ENGINEER OR REGISTERED ARCHITECT, WHICH DETAIL AND JUSTIFY THE DEVIATION.
- WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
- WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
- SELF DRILLING SCREWS SHALL BE SAE GRADE 5 INSTALLED WITH FULL ENGAGEMENT OF THREADS INTO METAL HOST STRUCTURE AND MAY HAVE EITHER A FLAT HEAD, PAN HEAD, TRUSS HEAD, OR OTHER HEAD STYLES. PROVIDE (5) PITCHES MIN. PAST THE THREAD PLANE.

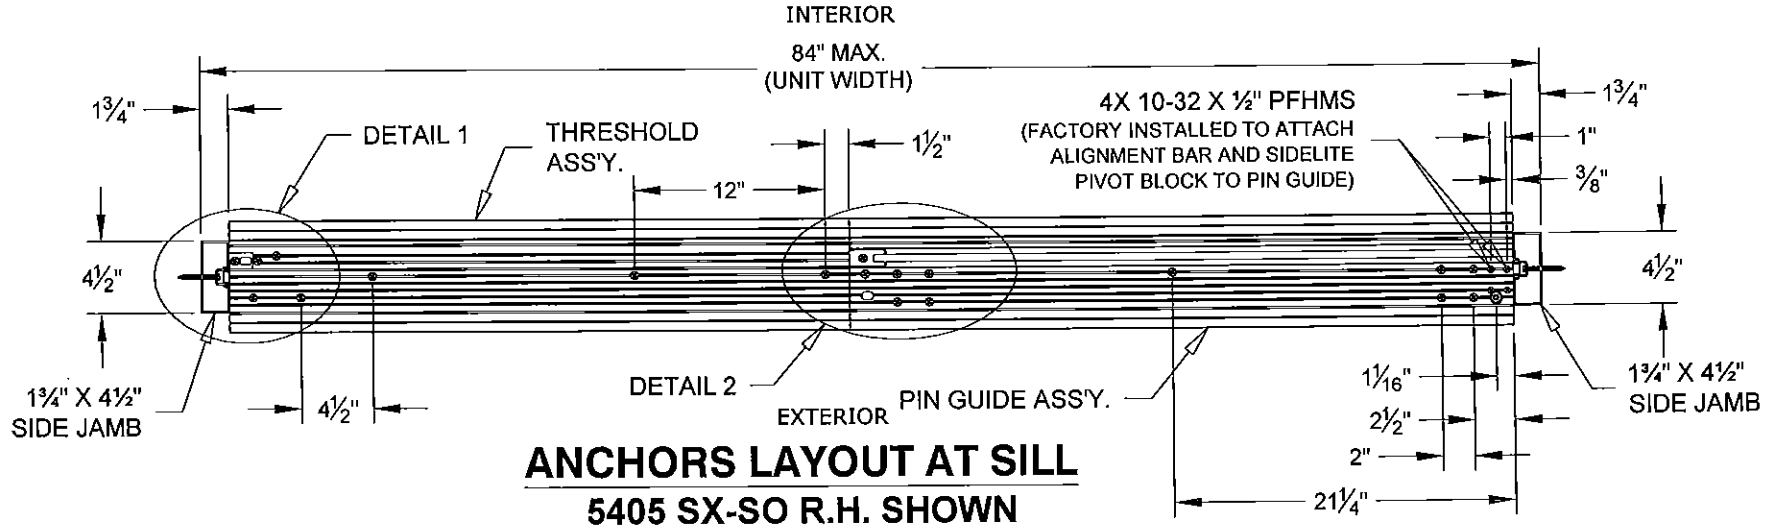

**ANCHORS LAYOUT AT SILL
5405 SX-SO R.H. SHOWN
5404 SO-SX L.H. OPPOSITE**

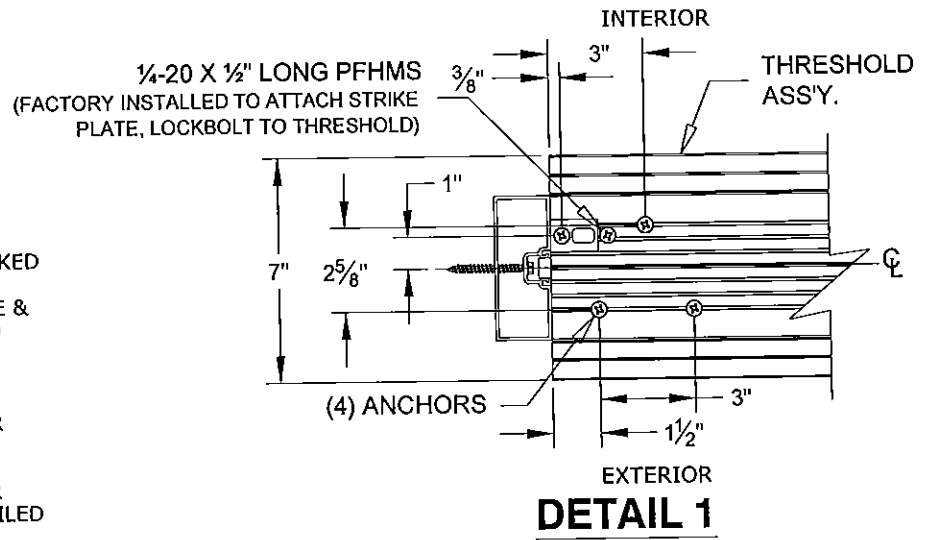

DETAIL 1

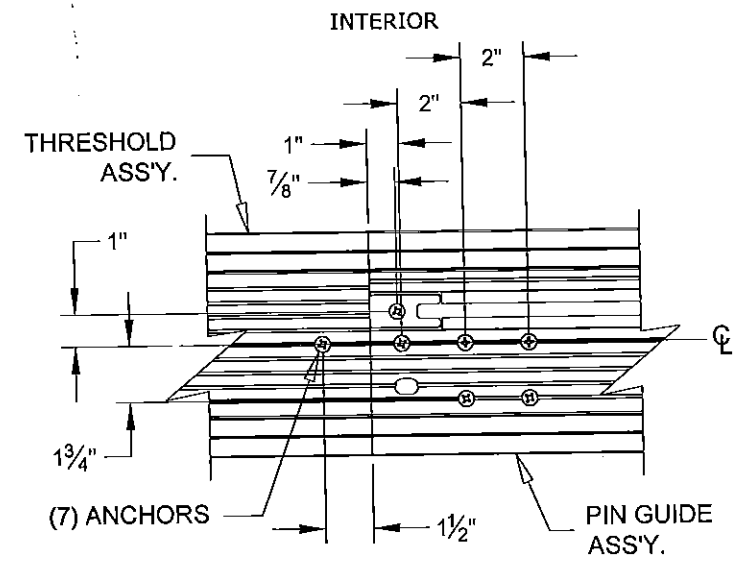

DETAIL 2

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 15-0316-04
Expiration Date 3/17/20
By *Shay L...*
Miami Dade Product Control

FRANK L. BENNARDO, P.E.
No. 46540
STATE OF FLORIDA
PROFESSIONAL ENGINEER
EXPRESSIONS
160 SW 12th AVE SUITE #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-4443
WWW.ENGEXP.COM
CERT. OF AUTH. #8885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

RECORD-USA
4324 HARGETT COURT
MONROE, NC 28110
(704) 289 - 9212

**SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE**


REMARKS	DRWN	CHKD	DATE
INIT. ISSUE	AVL	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/01/08
2010 FBC (09-REU-0001)	KL	FLB	03/19/12
REV FBC 2014	RWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. - ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.


14-2163
SCALE:
PAGE DESCRIPTION:
23

V:\Projects\14-2163 NOA-Update 12-0403.06 (09-REL-0001) for 2014 FBC-Renewal\WP14-2163a_09-REL-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg


02/11/2015 - 11:23am rickn

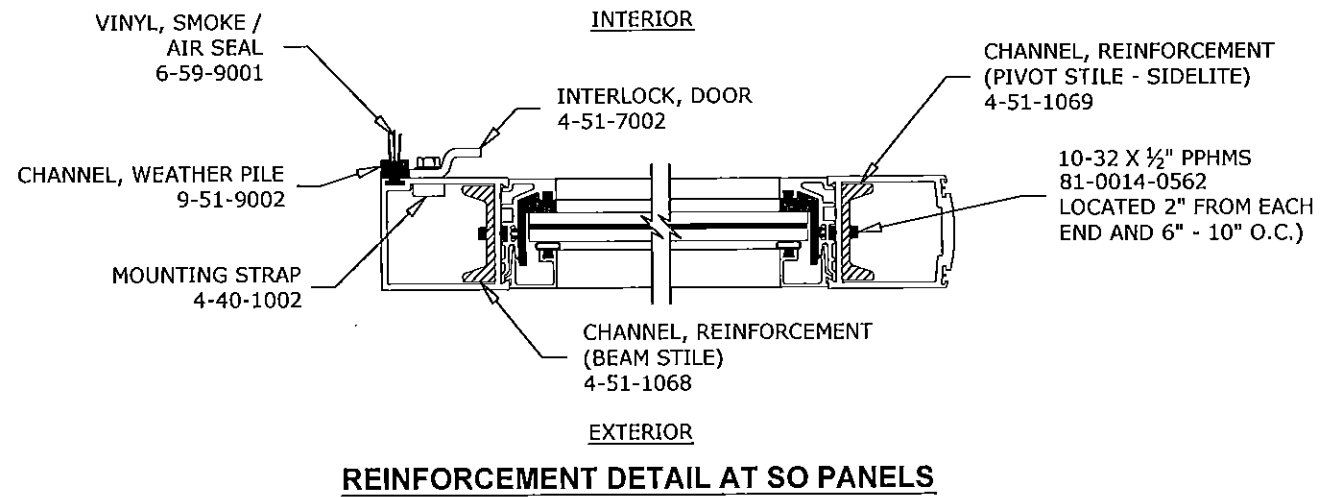


REINFORCEMENT DETAIL AT SO PANELS

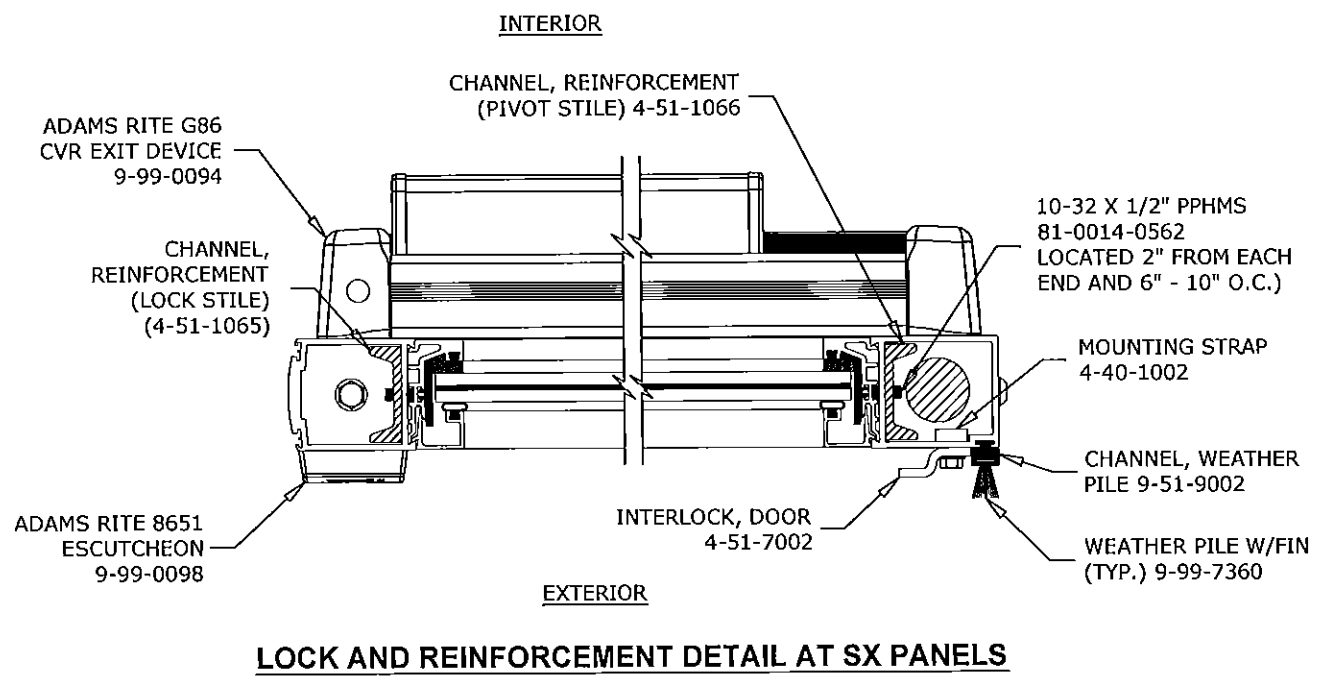

LOCK AND REINFORCEMENT DETAIL AT SX PANELS

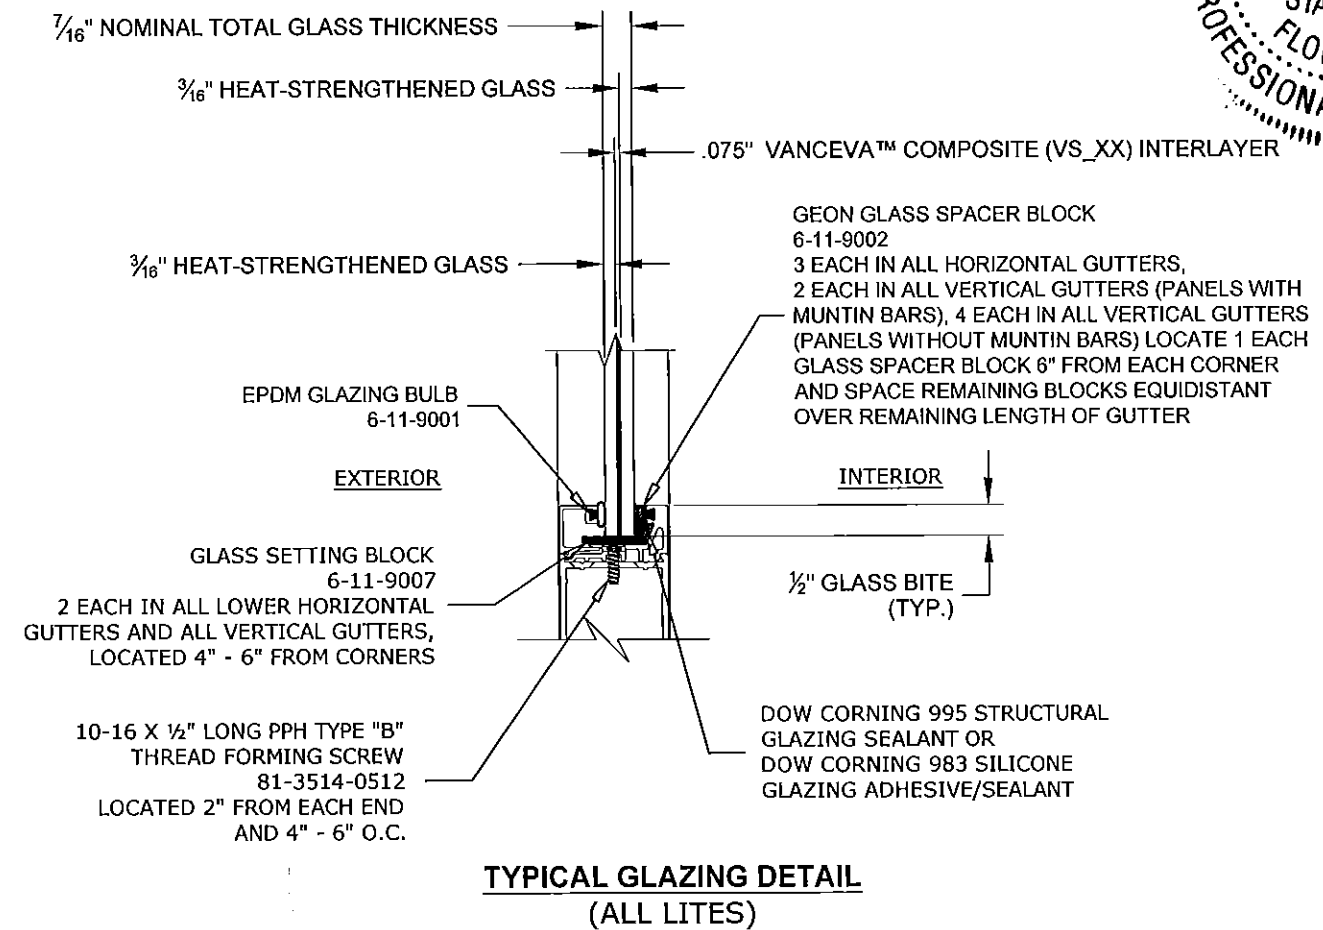

TYPICAL GLAZING DETAIL (ALL LITES)

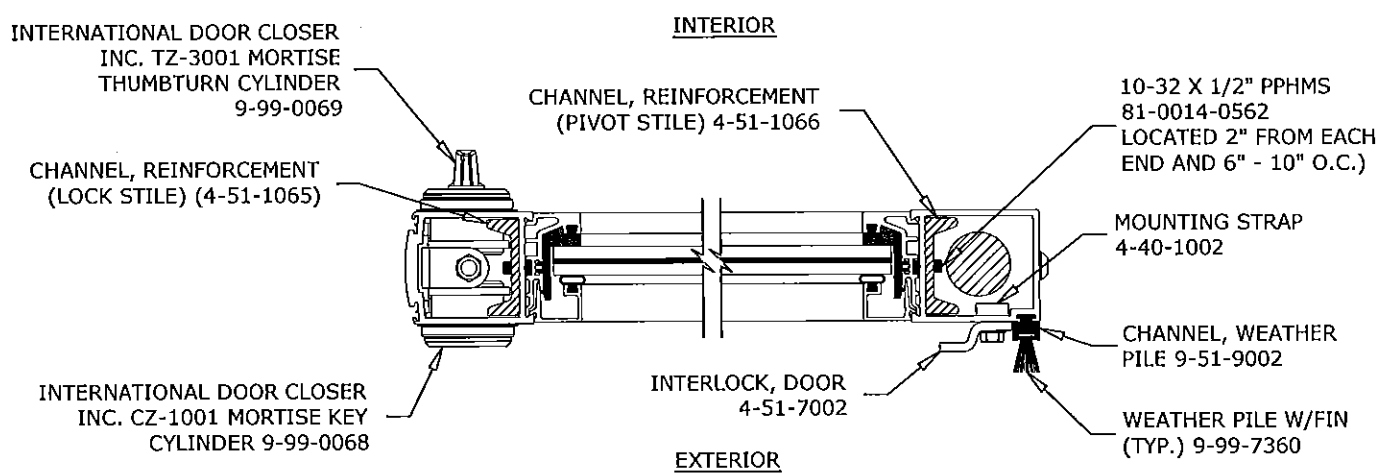

LOCK AND REINFORCEMENT DETAIL AT SX PANELS

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 15-0316.04
 Expiration Date 3/17/20
 By Ishing J. Chandra
 Miami Dade/Product Control

FRANK L. BENNARDO, P.E.
 LICENSE No. 46549
 PROFESSIONAL ENGINEER
 STATE OF FLORIDA
 160 SW 12th AVENUE, SUITE 4006
 DEERFIELD BEACH, FL 33442
 Ph: (954) 354-0660 Fax: (954) 354-0643
 WWW.ENGEXP.COM
 CERT. OF AUTH. #8888
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212


SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	AML	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-REL-0001)	KL	FLB	03/19/12
REV FBC 2014	RWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. IT SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. * ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
 SCALE: -
 PAGE DESCRIPTION:
 10


02/11/2015 - 11:23am rickn V:\Projects\14-2163 NOA-Update 12-0403.06 (09-REU-0001) for 2014 FBC-Renewal\WP14-2163a_09-REU-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg

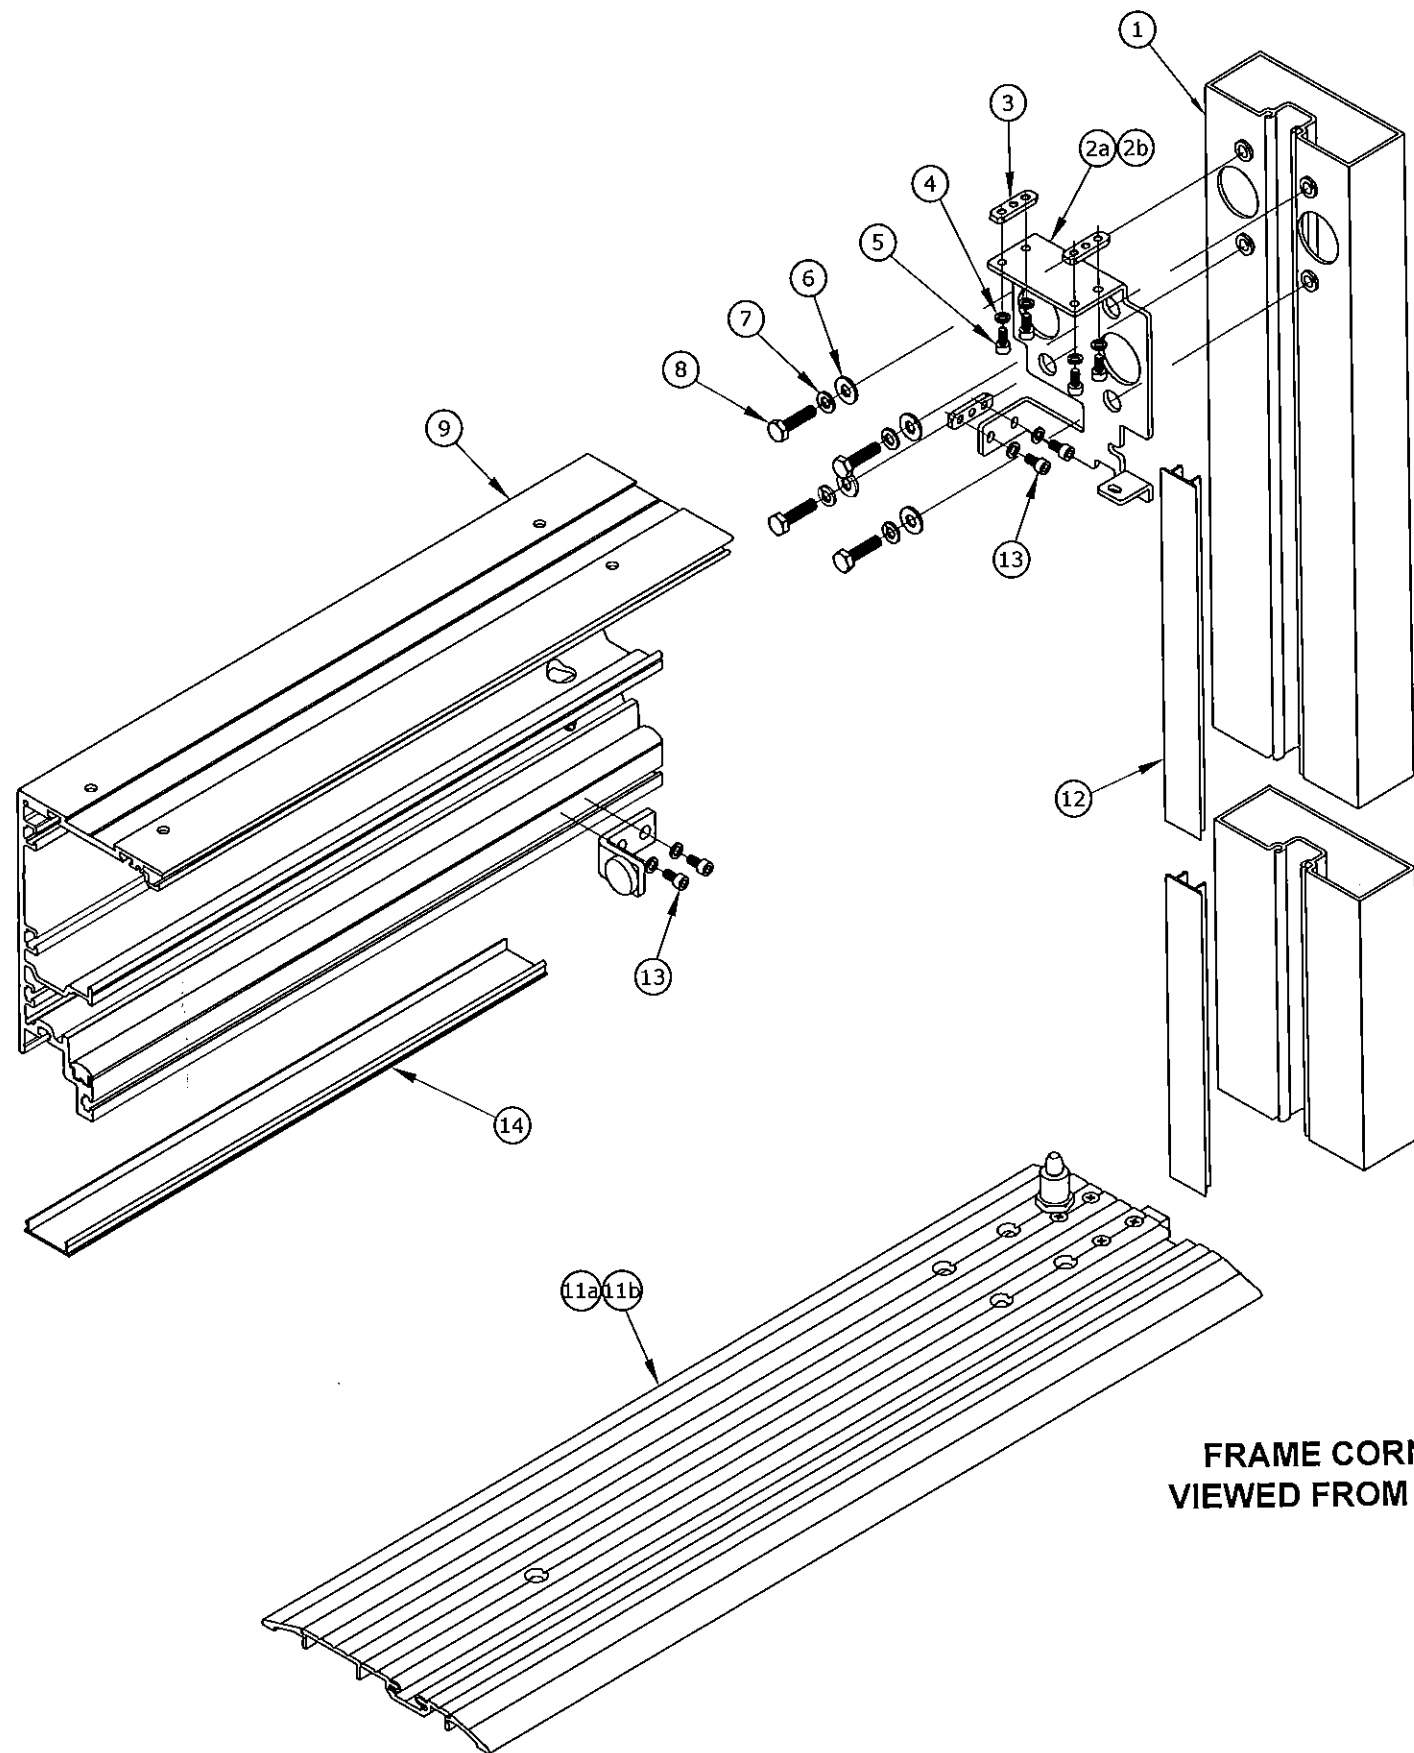

FRAME CORNER DETAILS
VIEWED FROM INTERIOR SIDE

HEADER / SIDE JAMB CORNER ATTACHMENT DETAIL			
ITEM NO.	PART NO.	DESCRIPTION	QUANTITY
1	5-60-1418	SIDE JAMB	2
2a	4-51-1055	BRACKET, HEADER MOUNTING - R.H.	1
2b	4-51-1056	BRACKET, HEADER MOUNTING - L.H.	1
3	4-51-1037	PLATE, NUT	8
4	9-99-7249	LOCK WASHER, SPLIT, #10	16
5	81-0016-2258	SCREW, 10-32 X 3/8" SHCS	8
6	9-99-7346	WASHER, 1/4" FLAT	8
7	9-99-7161	WASHER, 1/4" LOCK SPLIT	8
8	81-0088-3670	SCREW, 1/4-20 X 1" HHMS - GR. 8	8
9	5-51-4001	HEADER	1
10	4-51-0020	DOOR STOP ASS'Y.	2
11a	4-51-0150	PIN GUIDE THRESHOLD ASS'Y. - L.H.	1
11b	4-51-0151	PIN GUIDE THRESHOLD ASS'Y. - R.H.	1
12	5-60-1532	JAMB FILLER	2
13	81-0016-2562	SCREW, 10-32 X 1/2" SHCS	8
14	5-51-4003	FILLER, HEADER SOFFIT	3

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 15-0316-04
Expiration Date 3/17/20
By [Signature]
Miami Trade Product Control

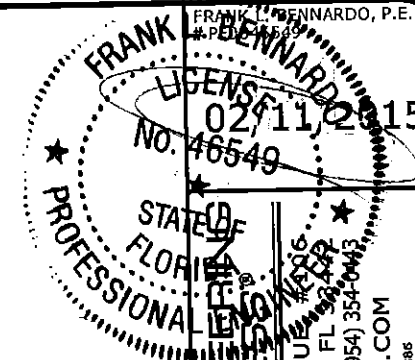

ENGINEERING EXPRESS
160 SW 12th Avenue, Suite 206
Deerfield Beach, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH. #0885
A FRANK L. BERNARDO, P.E., INC. INNOVATION

RECORD-USA
4324 HARGETT COURT
MONROE, NC 28110
(704) 289 - 9212
SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE



REMARKS	DRWN	CHKD	DATE
INIT. ISSUE	AMIL	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-REU-0001)	KL	FLB	03/19/12
REV FBC 2014	RWIN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BERNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BERNARDO, P.E. * ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
SCALE: -
PAGE DESCRIPTION:
11

V:\Projects\14-2163\NCA-Update 12-0403.06 (09-RELU-0001) for 2014, FBC-Renewal\WP14-2163_09-RELU-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg

02/11/2015 - 11:23am rickn

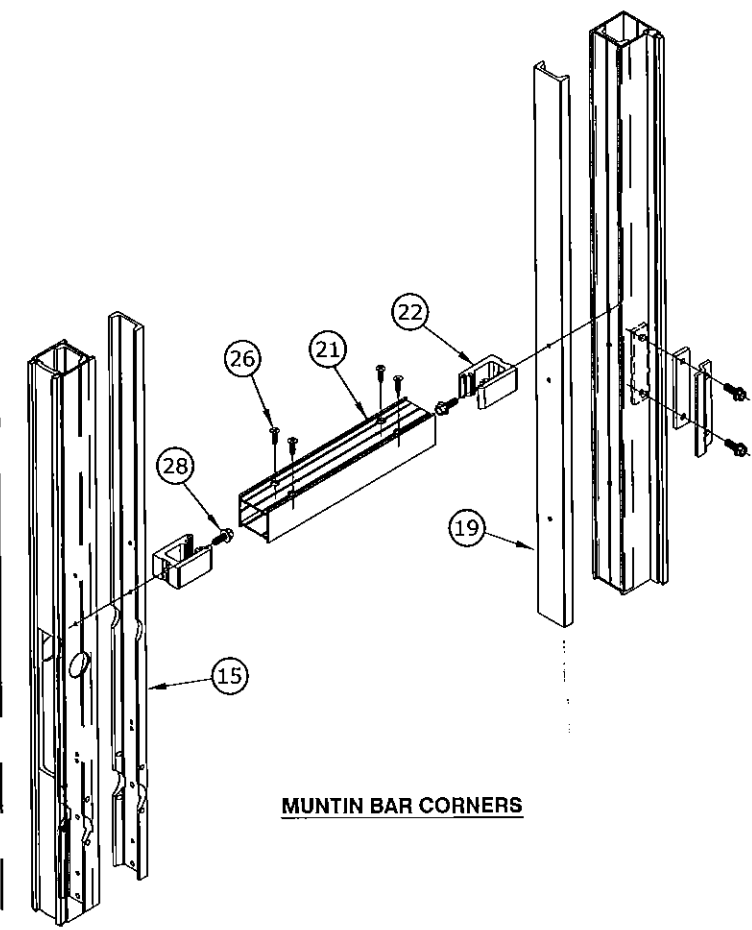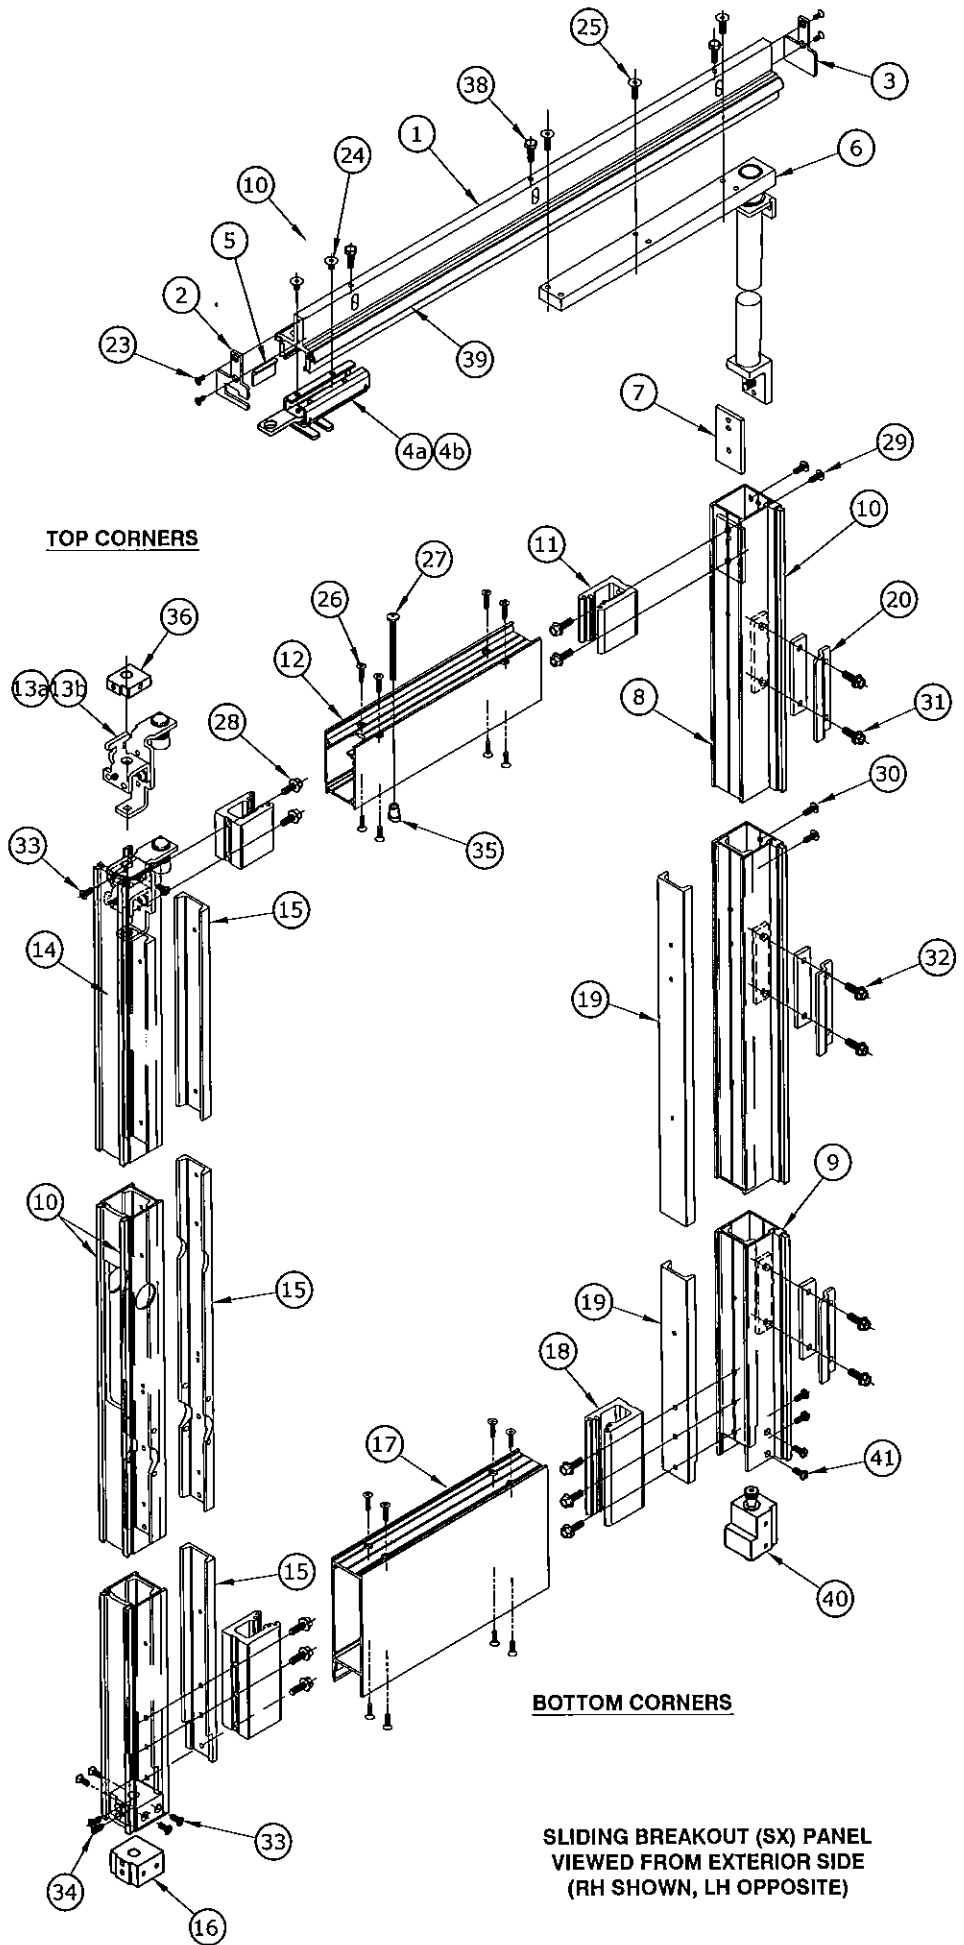

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 15-0316.04
 Expiration Date 3/17/2015
 By: [Signature]
 Initial Date Product Control

SLIDING BREAKOUT (SX) PANEL						
ITEM NO.	PART NO.	DESCRIPTION	QUANTITY			
			W/O MUNTIN BAR		W/MUNTIN BAR	
			L.H.	R.H.	L.H.	R.H.
1	51-4006	DOOR CATCH	1	1	1	1
2	4-59-1020	END CAP, DOOR CATCH (POSITIVE LATCH)	1	1	1	1
3	4-51-1049	END CAP, DOOR CATCH	1	1	1	1
4a	4-51-0027	DOOR CATCH ASS'Y. - L.H.	1	-	1	-
4b	4-51-0014	DOOR CATCH ASS'Y. - R.H.	-	1	-	1
5	4-51-9004	COVER, DOOR CATCH	1	1	1	1
6	4-51-0011	TORQUE BAR ASS'Y.	1	1	1	1
7	4-11-1082	PLATE, BACKER	1	1	1	1
8	5-11-4022	STILE, FIXED (NARROW)	1	1	1	1
9	6-51-9002	CHANNEL, WEATHER PILE	1	1	1	1
10	9-99-7360	WEATHER PILE W/FIN	A/R	A/R	A/R	A/R
11	4-11-4097	BLOCK, SHEAR	2	2	2	2
12	5-51-4009	RAIL - 3"	1	1	1	1
13a	4-51-0015	INTERLOCK ASS'Y. - L.H.	1	-	1	-
13b	4-51-0016	INTERLOCK ASS'Y. - R.H.	-	1	-	1
14	5-11-4021	STILE, TANDEM (NARROW)	1	1	1	1
15	4-51-1065	CHANNEL, REINFORCEMENT (LOCK STILE)	1	1	1	1
16	4-51-9007	BLOCK, FLUSHBOLT SUPPORT	1	1	1	1
17	5-11-4036	RAIL - 6"	1	1	1	1
18	4-51-4151	BLOCK, SHEAR	2	2	2	2
19	4-51-1066	CHANNEL, REINFORCEMENT (PIVOT STILE)	1	1	1	1
20	4-51-7002	INTERLOCK, DOOR	5	5	5	5
21	5-11-4031	MUNTIN BAR	-	-	1	1
22	4-11-4096	BLOCK, SHEAR	-	-	2	2
23	81-3511-0412-DB	SCREW, 8-18 X 1/2" PFHMS, TYPE B	4	4	4	4
24	81-0011-2658	SCREW, 1/4-20 X 3/8" SFCCHS	2	2	2	2
25	81-0011-2670	SCREW, 1/4-20 X 1" SFCCHS	3	3	3	3
26	81-4411-0516	SCREW, 10-24 X 3/4" PFHMS, TYPE 23	16	16	20	20
27	81-0014-0688	SCREW, 1/4-20 X 3" PPHMS	1	1	1	1
28	81-0017-3666	SCREW, 1/4-20 X 3/4" HWHMS, GR. 8	10	10	12	12
29	81-0016-2658	SCREW, 1/4-20 X 3/8" BSHCS - S.S.	2	2	2	2
30	81-0014-2670	SCREW, 1/4-20 X 1" BSHCS - S.S.	2	2	2	2
31	81-0017-3662	SCREW, 1/4-20 X 1/2" HWHMS, GR. 8	2	2	2	2
32	81-0017-3664	SCREW, 1/4-20 X 3/8" HWHMS, GR. 8	8	8	8	8
33	81-0011-0562	SCREW, 10-32 X 1/2" PFHMS	7	7	7	7
34	9-99-0113	PLUNGER, SPRING LOADED	1	1	1	1
35	9-99-2596	BLOCK, GLASS JACKING	1	1	1	1
36	4-51-4265	BLOCK, HEX BOLT GUIDE	1	1	1	1
37	4-40-1002	MOUNTING STRAP	5	5	5	5
38	81-0718-3666	SCREW, 1/4-20 X 3/4" HHMS, GR. 5 W/NYLOC STRIP	3	3	3	3
39	6-11-9009	SEAL, BULB W/FIN	A/R	A/R	A/R	A/R
40	4-51-0093	BOTTOM GUIDE ASS'Y.	1	1	1	1
41	81-0074-0562	SCREW, 10-32 X 1/2" PPHMS - STAINLESS STEEL	4	4	4	4

FRANK L. BENNARDO, P.E.
 #PE0046549
 02/11/2015
 NO. 46549
 PROFESSIONAL ENGINEER
 EXPRESSED
 160 SW 12th AVE SUITE #106
 DEERFIELD BEACH, FL 33442
 PH: (954) 354-0660 FAX: (954) 354-3643
 WWW.ENGEXP.COM
 CERT. OF AUTH. #8885
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212



SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	AMIL	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-RELU-0001)	KL	FLB	03/19/12
REV FBC 2014	RWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. * ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
 SCALE:
 PAGE DESCRIPTION:
 23
 12


V:\Projects\14-2163 NOA-Update 12-0403.06 (09-REU-0001) for 2014 FBC-Renewal\VP\14-2163a_09-REU-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg
 02/11/2015 - 11:23am rickn

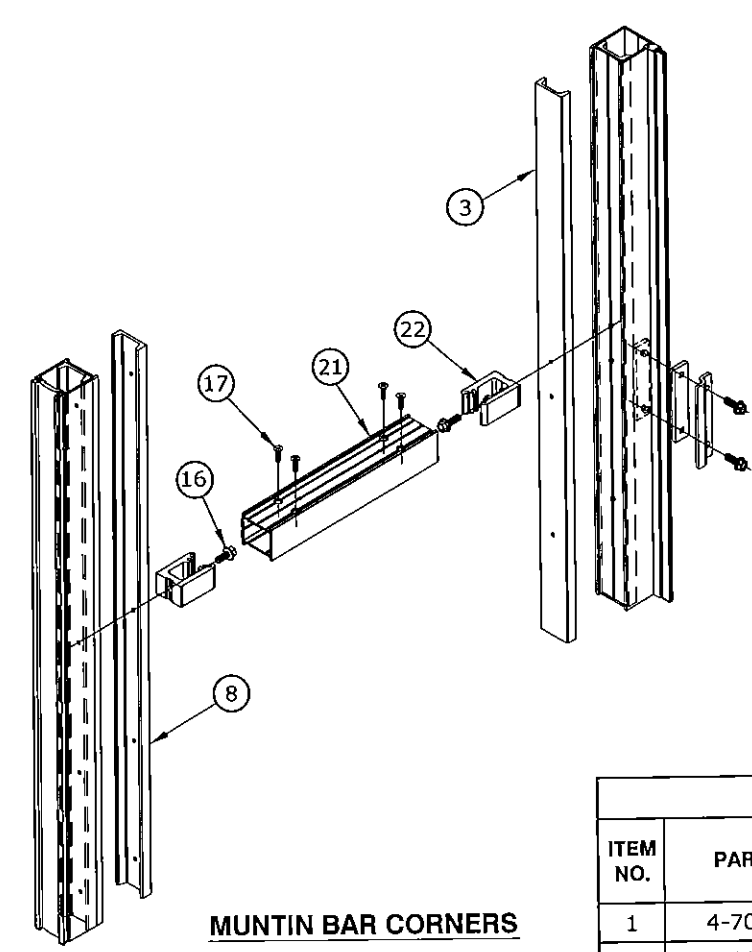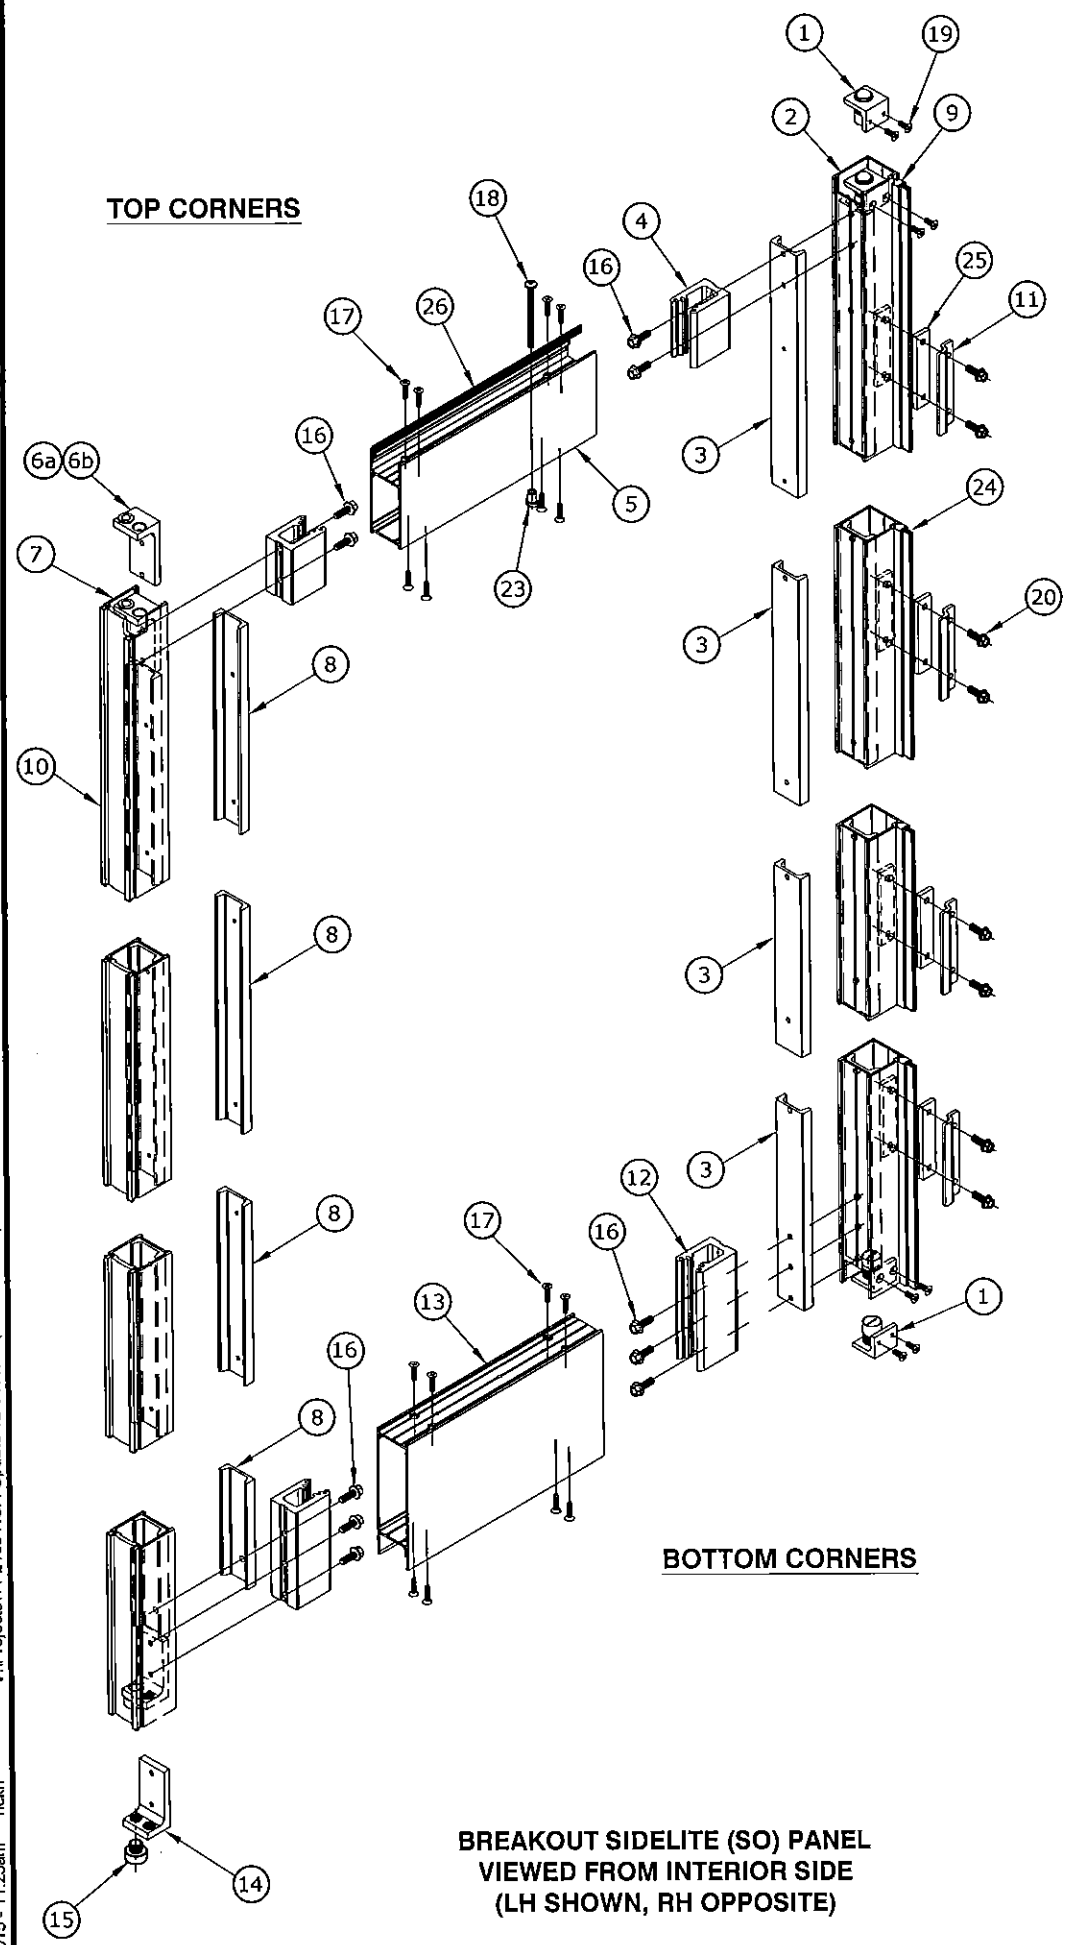

MUNTIN BAR CORNERS

BREAKAWAY SIDELITE (SO) PANEL						
ITEM NO.	PART NO.	DESCRIPTION	QUANTITY			
			W/O MUNTIN BAR		W/MUNTIN BAR	
			L.H.	R.H.	L.H.	R.H.
1	4-70-0672	ROLLER CATCH ASS'Y.	2	2	2	2
2	5-11-4022	STILE, FIXED (NARROW)	1	1	1	1
3	4-51-1068	CHANNEL, REINFORCEMENT (BEAM STILE)	1	1	1	1
4	4-11-4098	BLOCK, SHEAR	2	2	2	2
5	5-11-4034	RAIL - 4"	1	1	1	1
6a	4-11-0432	ANGLE ASS'Y., SIDELITE PIVOT (TOP) - L.H.	1	-	1	-
6b	4-11-0433	ANGLE ASS'Y., SIDELITE PIVOT (TOP) - R.H.	-	1	-	1
7	5-11-4021	STILE, TANDEM (NARROW)	1	1	1	1
8	4-51-1069	CHANNEL, REINFORCEMENT (PIVOT STILE)	1	1	1	1
9	6-51-9002	CHANNEL, WEATHER PILE	1	1	1	1
10	9-99-7360	WEATHER PILE W/FIN	A/R	A/R	A/R	A/R
11	4-51-7002	INTERLOCK, DOOR	5	5	5	5
12	4-51-4151	BLOCK, SHEAR	1	1	1	1
13	5-11-4036	RAIL - 6"	1	1	1	1
14	4-51-1067	ANGLE, SIDELITE PIVOT (BOTTOM)	1	1	1	1
15	4-51-7003	BUSHING, SIDELITE PIVOT (BOTTOM)	1	1	1	1
16	81-0017-3666	SCREW, 1/4-20 X 3/4" HWHMS, GR. 8	10	10	12	12
17	81-4411-0516	SCREW, 10-24 X 3/4" PFHMS, TYPE 23	16	16	20	20
18	81-0014-0690	SCREW, 1/4-20 X 3 1/2" PPHMS	1	1	1	1
19	81-0012-0562	SCREW, 10-32 X 5/16" PFUHMS	4	4	4	4
20	81-0017-3664	SCREW, 1/4-20 X 5/8" HWHMS, GR. 8	10	10	10	10
21	5-11-4031	MUNTIN BAR	-	-	1	1
22	4-11-4096	BLOCK, SHEAR	-	-	2	2
23	9-99-2596	BLOCK, GLASS JACKING	1	1	1	1
24	6-59-9001	VINYL, SMOKE / AIR SEAL	A/R	A/R	A/R	A/R
25	4-40-1002	MOUNTING STRAP	5	5	5	5
26	9-99-7361	SEAL, SIDELITE (TOP)	1	1	1	1

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 15-0316-04
 Expiration Date 3/1/20
 By Frank L. Bennardo
 Miami Dade Product Control

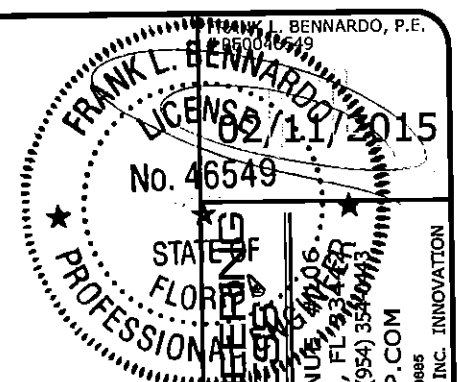

ENGINEERING EXPRESS
 160 SW 12th AVENUE, #1006
 DEERFIELD BEACH, FL 33442
 Ph: (954) 354-0660 Fax: (954) 354-0663
 WWW.ENGEXP.COM
 CERT. OF AUTH. #8885
 A FRANK L. BENNARDO, P.E., INC. INNOVATION


RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212
 SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	AML	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-REU-0001)	KL	FLB	03/19/12
REV FBC 2014	RWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. - ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
 SCALE: -
 PAGE DESCRIPTION:
 13

V:\Projects\14-2163 NOA-Update 12-04-03-06 (09-REU-0001) for 2014 FBC-Renewal\VP114-2163a_09-REU-0001_02a 5400 LHM HR Sliders (NOA) - Revised Per Comments.dwg 02/11/2015 - 11:23am rickn

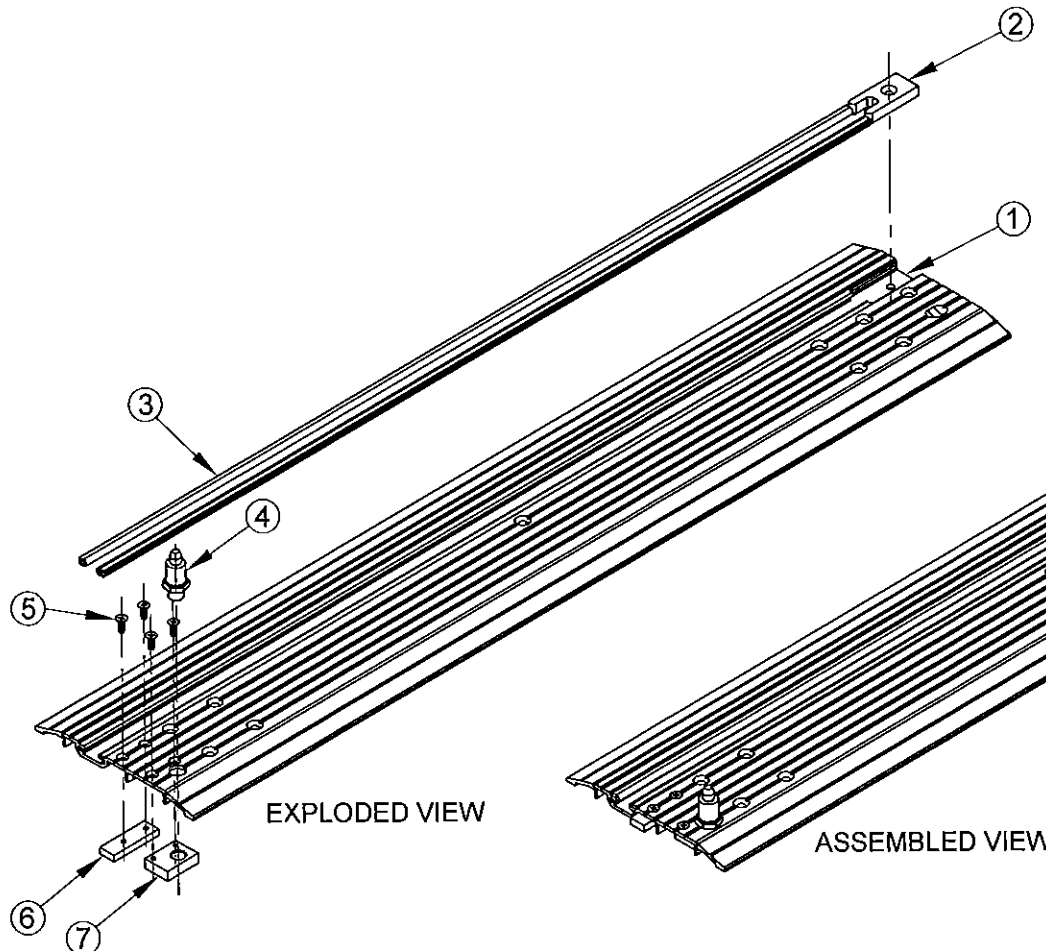


EXPLODED VIEW

ASSEMBLED VIEW

PIN GUIDE THRESHOLD ASS'Y. - L.H.

PART NO.: 4-51-0160
SCALE: 1" = 6"

BILL OF MATERIALS			
ITEM NO.	PART NO.	DESCRIPTION	QTY.
1	4-51-4260	PIN GUIDE THRESHOLD MACHINING - L.H.	1
2	4-51-7005	PLATE, PIN GUIDE SUPPORT	1
3	9-70-0077	BUMPER, PIN GUIDE	2
4	4-11-1031	PIN, SIDELITE PIVOT (BOTTOM)	1
5	81-0011-0562	SCREW, 10-32 X 1/2" FFHMS	4
6	4-51-4009	BAR, ALIGNMENT (PIN GUIDE THRESHOLD)	1
7	4-51-4265	BLOCK, SIDELITE PIVOT (BOTTOM)	1

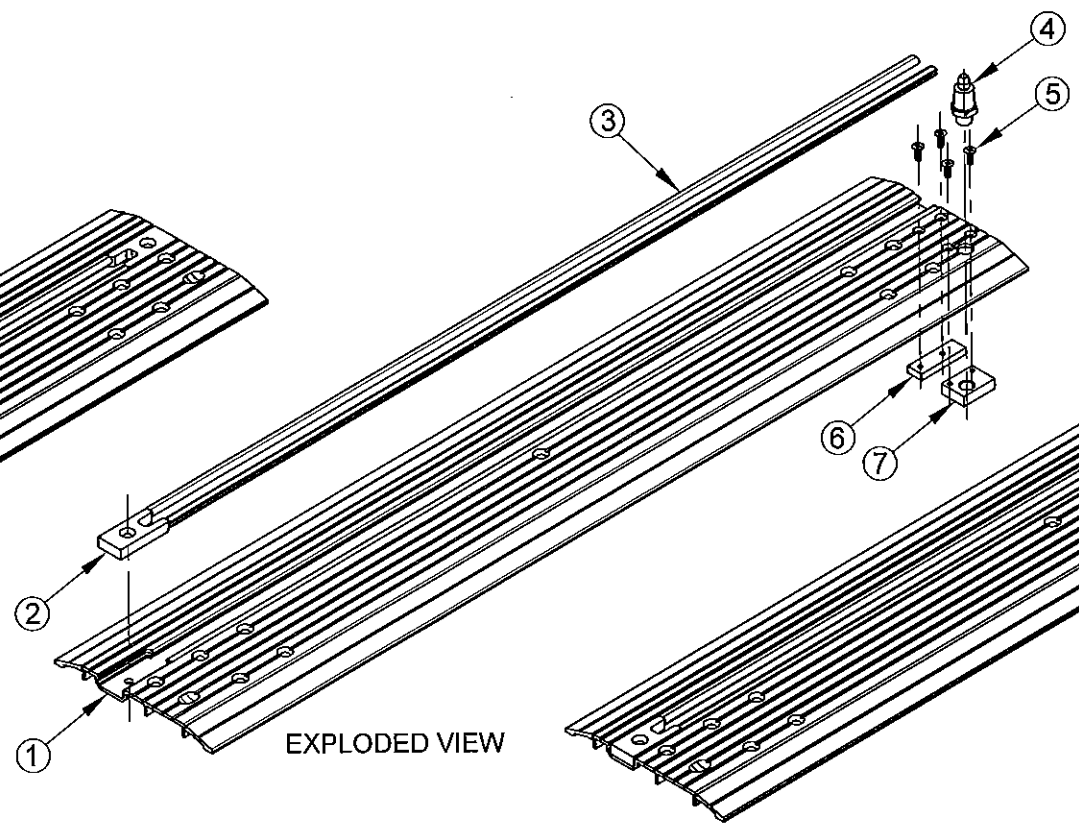

EXPLODED VIEW

ASSEMBLED VIEW

PIN GUIDE THRESHOLD ASS'Y. - R.H.

PART NO.: 4-51-0161
SCALE: 1" = 6"

BILL OF MATERIALS			
ITEM NO.	PART NO.	DESCRIPTION	QTY.
1	4-51-4261	PIN GUIDE THRESHOLD MACHINING - R.H.	1
2	4-51-7005	PLATE, PIN GUIDE SUPPORT	1
3	9-70-0077	BUMPER, PIN GUIDE	2
4	4-11-1031	PIN, SIDELITE PIVOT (BOTTOM)	1
5	81-0011-0562	SCREW, 10-32 X 1/2" FFHMS	4
6	4-51-4009	BAR, ALIGNMENT (PIN GUIDE THRESHOLD)	1
7	4-51-4265	BLOCK, SIDELITE PIVOT (BOTTOM)	1

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 15-0316-04
Expiration Date 3/17/20
By [Signature]
Miami Dade Product Control

FRANK L. BENNARDO, P.E.
#PE000465

FRANK L. BENNARDO
LICENSE No. 02121100
No. 46549

STATE OF FLORIDA
PROFESSIONAL ENGINEERING EXPRESS

160 SW 12TH AVENUE, SUITE 1106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGGEXP.COM
CERT. OF AUTH. #8885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

RECORD-USA
4324 HARGETT COURT
MONROE, NC 28110
(704) 289 - 9212

SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DATE	DRWN	CHKD
INIT ISSUE	06/26/09	AML	KL
REV. PER BCCO COMMENT	12/01/09	KL	FLB
2010 FBC (09-REU-0001)	03/19/12	KL	FLB
REV FBC 2014	02/09/15	RWN	CSL

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. * ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163



SCALE: _____

PAGE DESCRIPTION: _____



14

23

FRANK L. BERNARDO, P.E.
 LICENSE NO. 46549
 STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 ENGINEERING EXPRESS, INC.
 160 SW 12th AVENUE, SUITE 106
 DEERFIELD BEACH, FL 33442
 PH: (954) 354-0660 FAX: (954) 354-0663
 WWW.ENGEXP.COM
 CERT. OF AUTH. #886
 A. FRANK L. BERNARDO, P.E., INC. INNOVATION

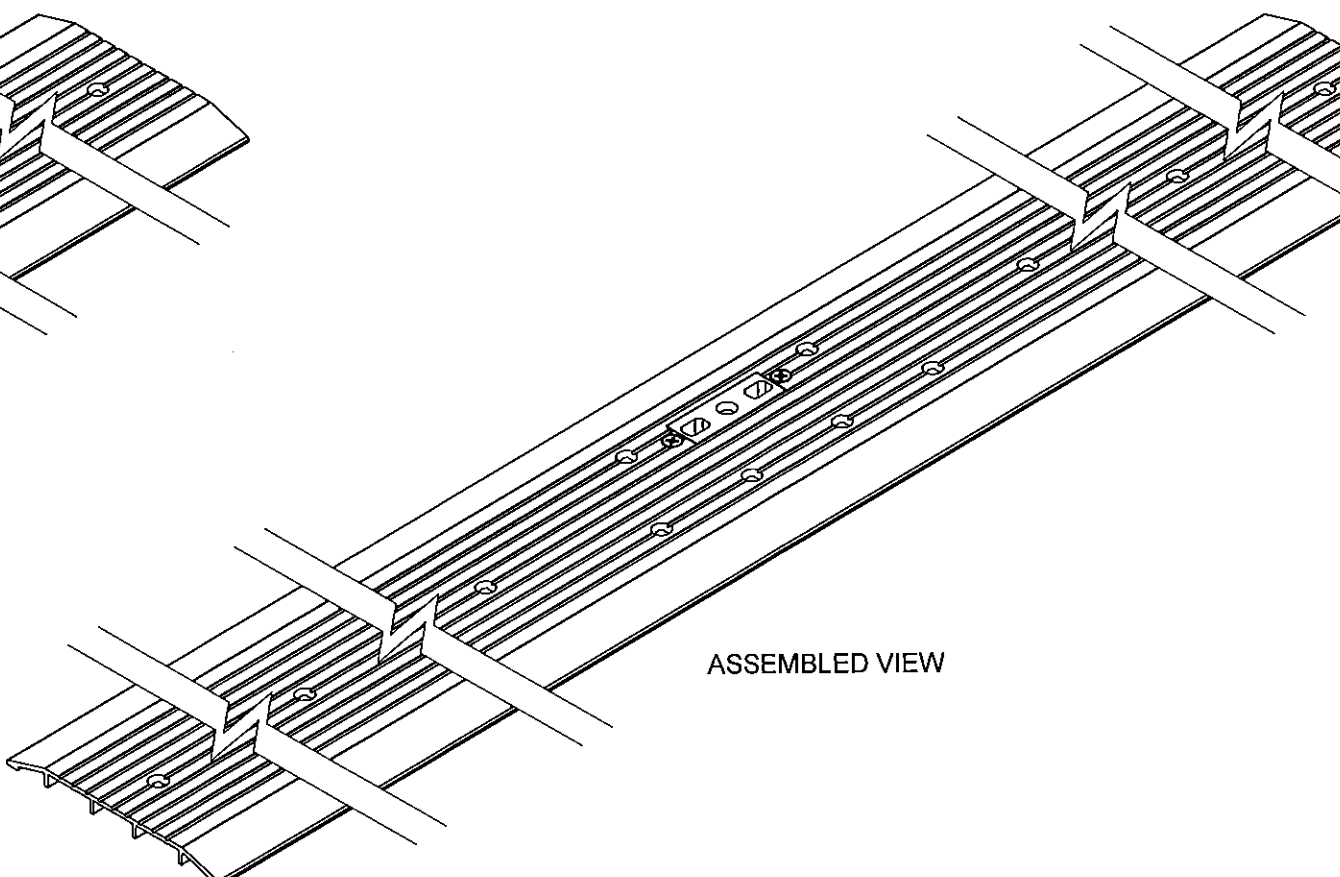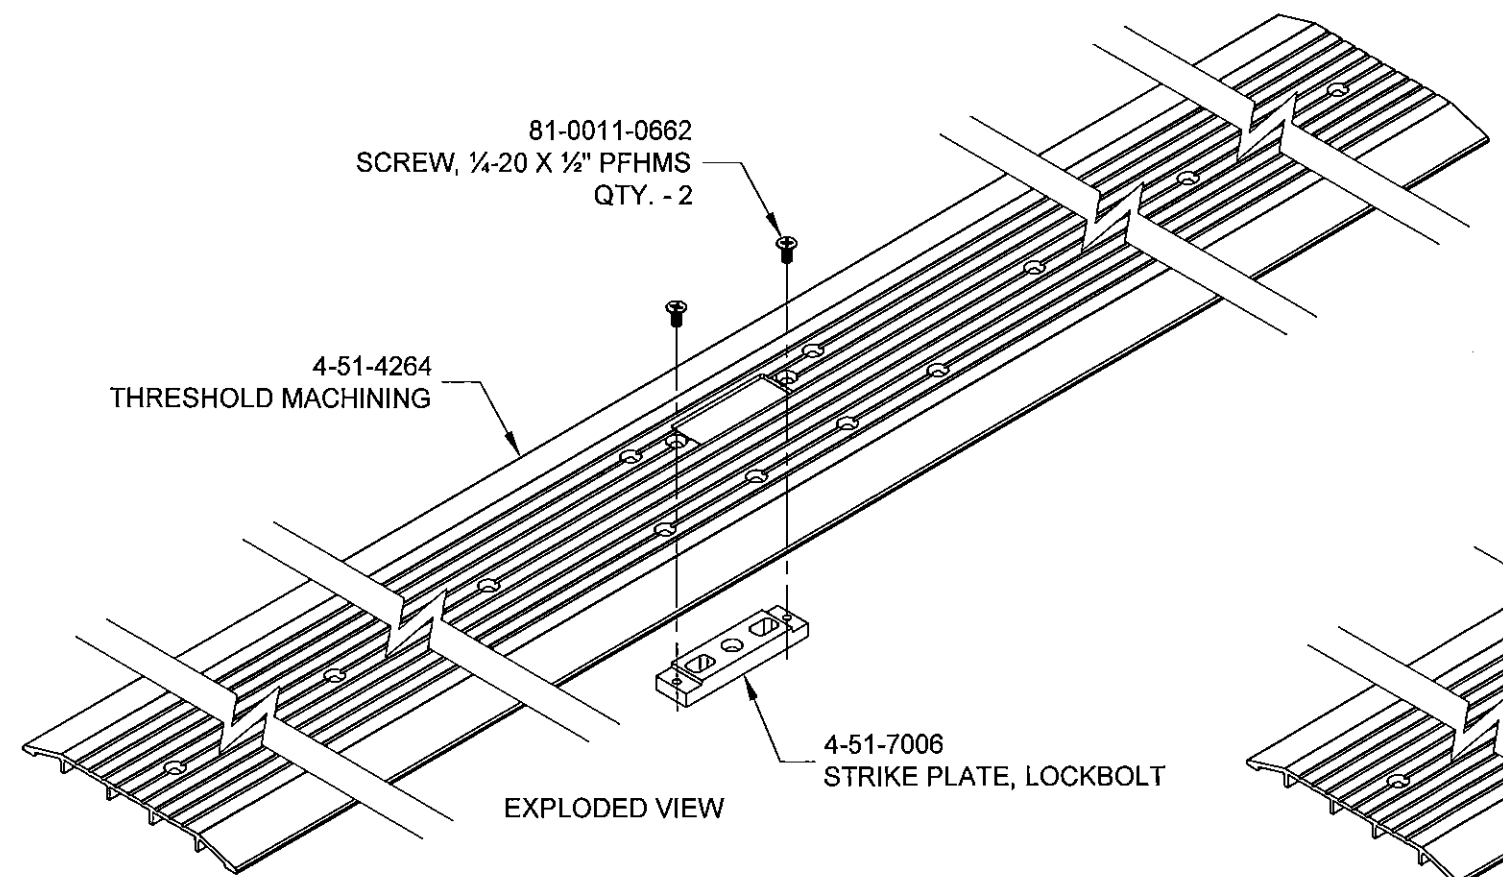

THRESHOLD ASS'Y. - BIPART
 PART NO.: 4-51-0164
 SCALE: 1/4" = 1"

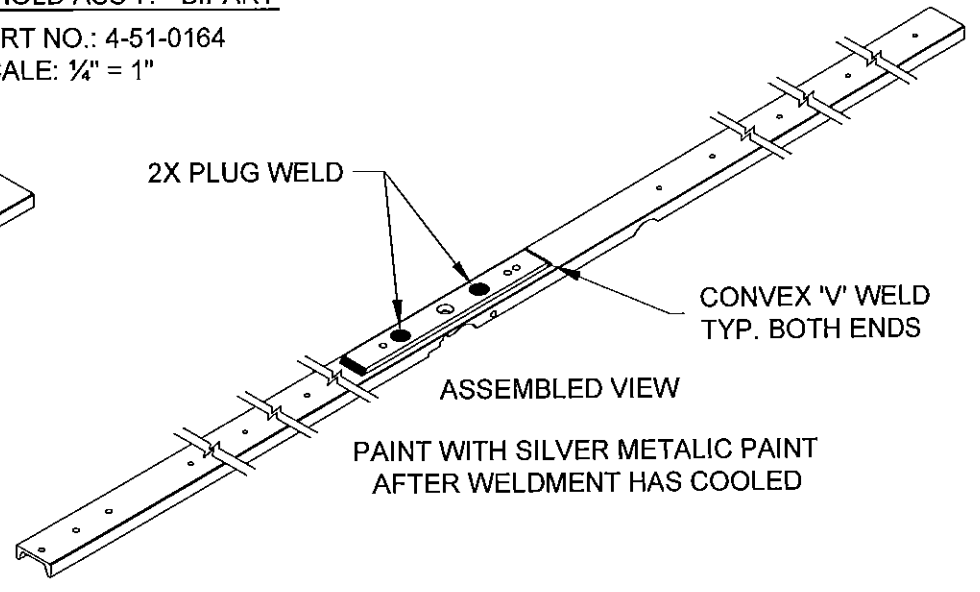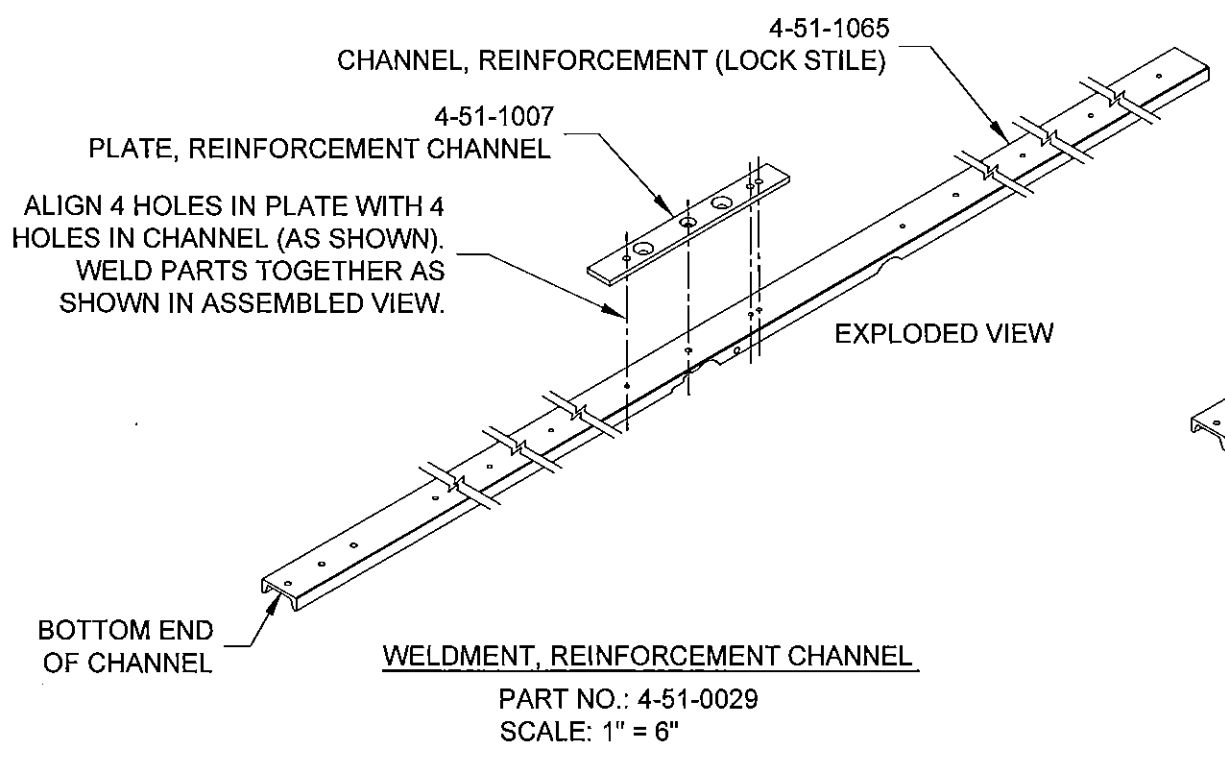

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 15-0316-04
 Expiration Date 3/17/20
 By *[Signature]*
 Miami Dade Product Control

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212

SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE














REMARKS	DRWN	CHKD	DATE
INIT. ISSUE	AML	KL	06/28/09
REV. PER BCC COMMENT	KL	FLB	12/01/09
2010 FBC (09-RELJ-0001)	KL	FLB	03/19/12
REV. FBC 2014	RWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BERNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BERNARDO, P.E. * ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
 SCALE:
 PAGE DESCRIPTION:
 15

V:\Projects\14-2163 NOA-Update 12-04-03.dwg (09-RELJ-0001) for 2014 FBC-Renewal\WP\14-2163a_09-RELJ-0001_02a 5400 Lvl1 HR Sliders (NOA) - Revised Per Comments.dwg
 02/11/2015 - 11:23am rickn

V:\Projects\14-2163 NOA-Update 12-0403.06 (09-REU-0001) for 2014 FBC-Renewal\WP\14-2163a_09-REU-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg
 02/11/2015 - 11:23am rickn

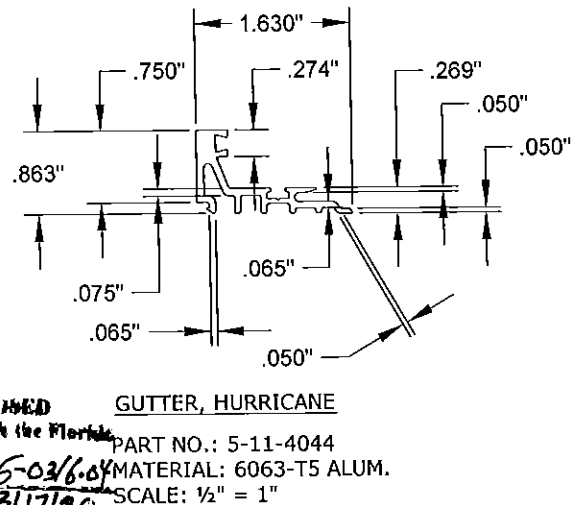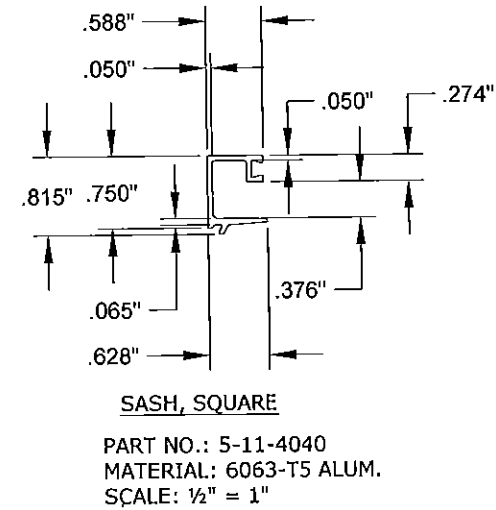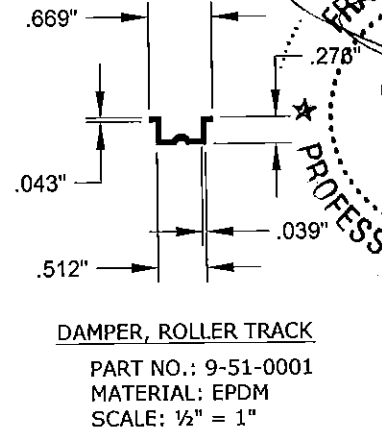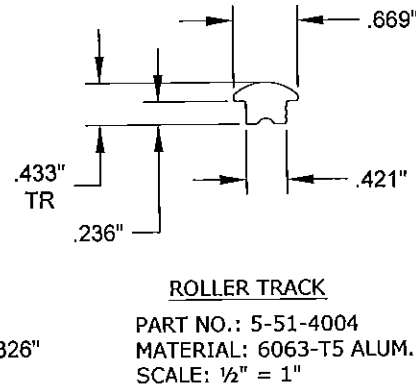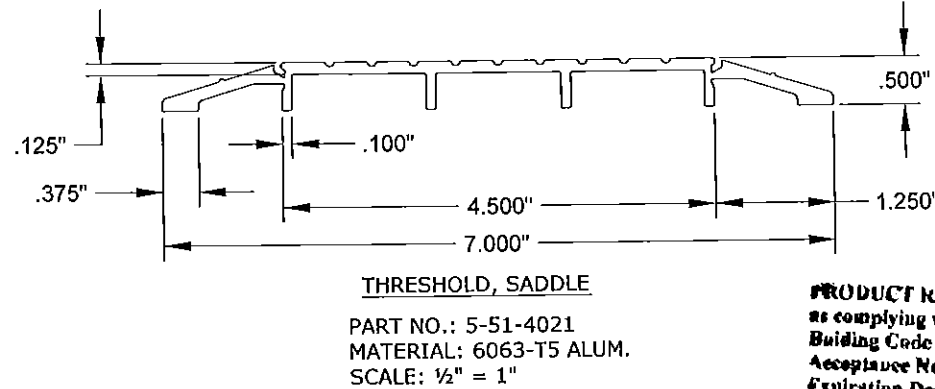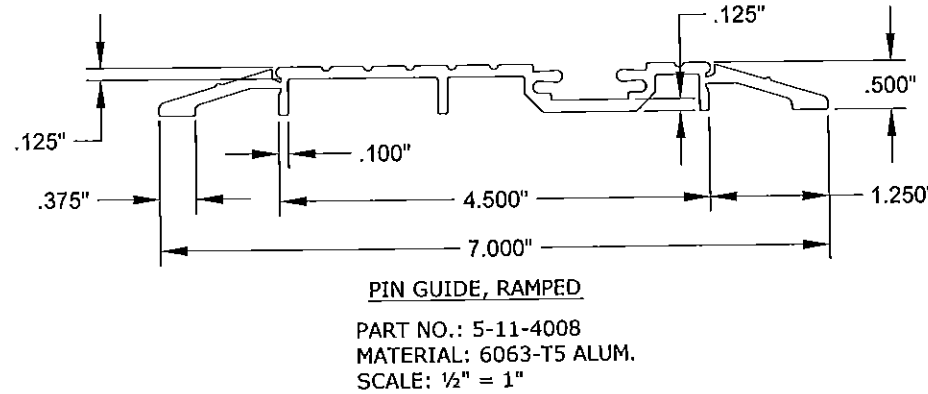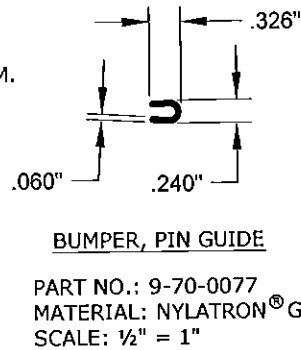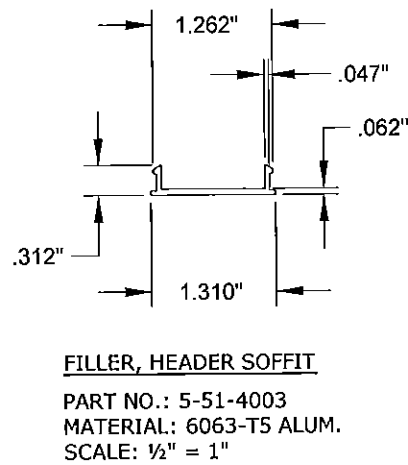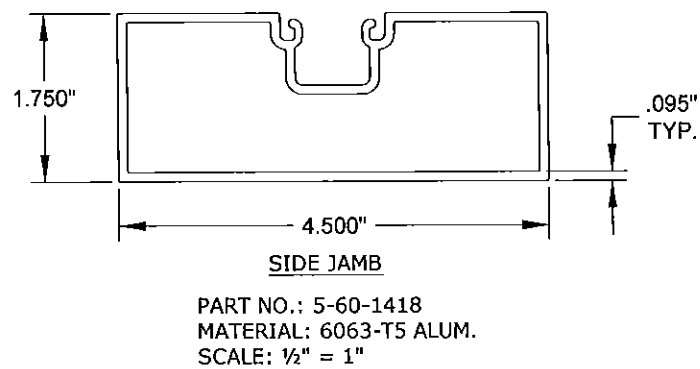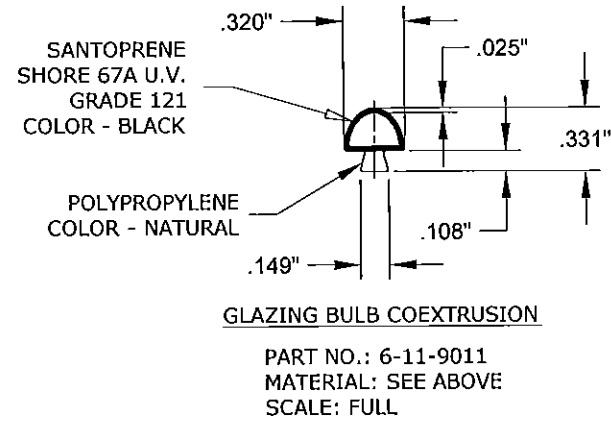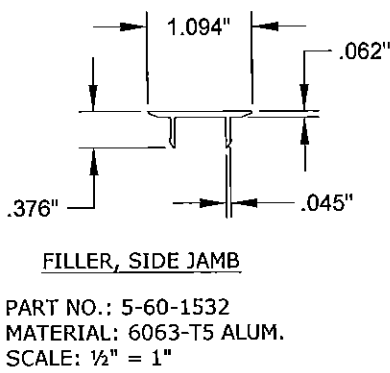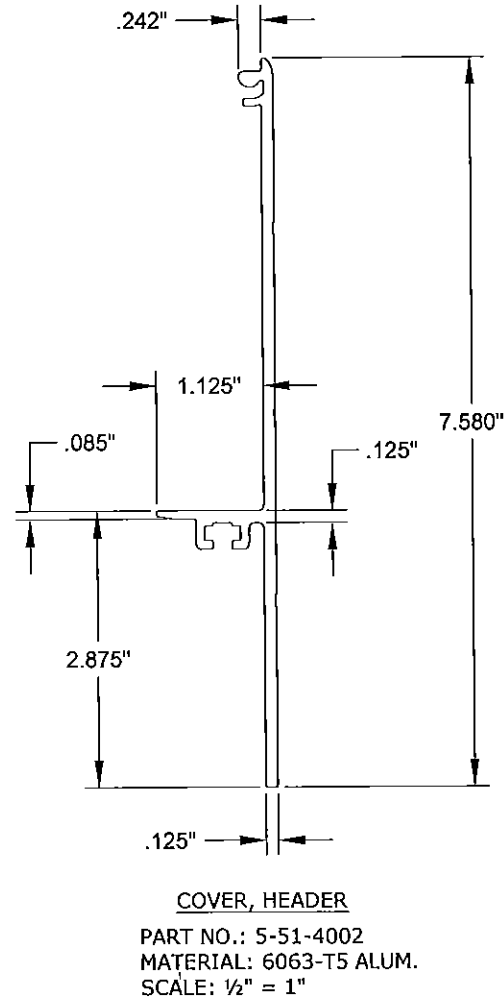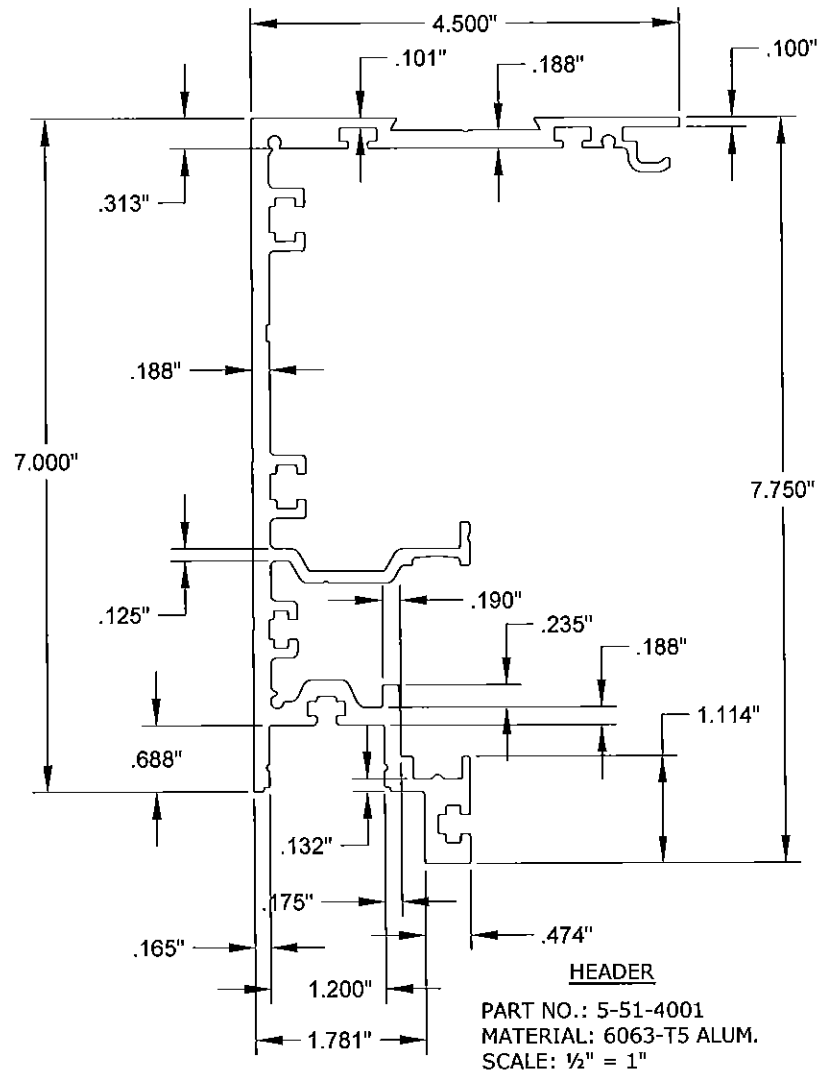

PRODUCT REVIEWED
 as complying with the Florida Building Code
 Acceptance No. 15-02/6.04
 Expiration Date 3/17/20
 By *Cheryl L. ...*
 Miami Dade Product Control

NOTE: ALL ALUMINUM EXTRUSIONS SHALL HAVE A MINIMUM Fu=31 ksi & Fy=26200 psi.

FRANK L. BENNARDO, P.E.
 No. 46549
 PROFESSIONAL ENGINEERING
 ENGINEERING EXPRESS
 160 SW 12th Avenue, #106
 DEERFIELD BEACH, FL 33442
 Ph: (954) 354-0660 Fax: (954) 354-3888
 WWW.ENGGEXP.COM
 CERT. OF AUTH. #9885
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212


SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT. ISSUE	AVL	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-REU-0001)	KL	FLB	03/19/12
REV FBC 2014	RWN	CSL	02/09/15


THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. * ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
 SCALE: -
 PAGE DESCRIPTION:
 16


V:\Projects\14-2163 NDA-Update 12-0403.06 (09-REU-0001) for 2014 FBC-Renewal\WP\14-2163a_09-REU-0001_02a-5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg
 02/11/2015 - 11:23am rick

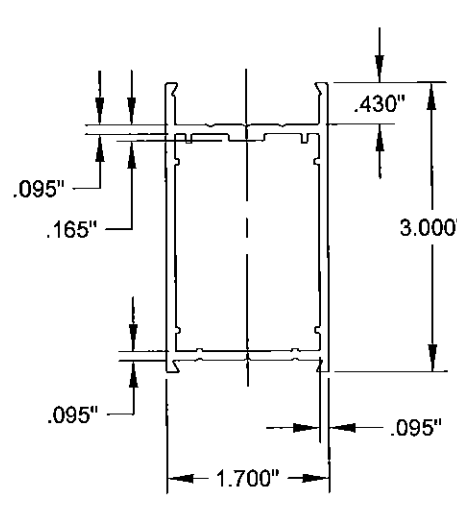


RAIL, TOP (SX PANEL)
 PART NO.: 5-51-4009
 MATERIAL: 6063-T5 ALUM.
 SCALE: 1/2" = 1"

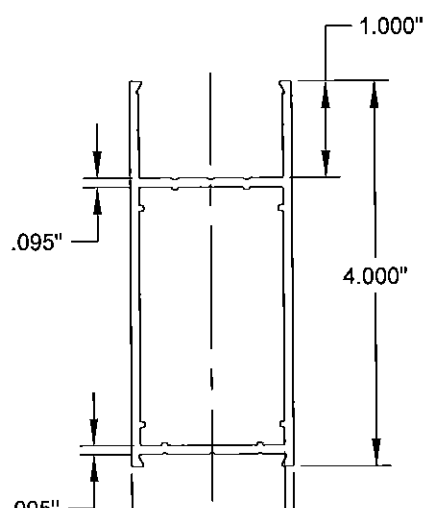


RAIL, TOP (SO PANEL)
 PART NO.: 5-11-4034
 MATERIAL: 6063-T5 ALUM.
 SCALE: 1/2" = 1"

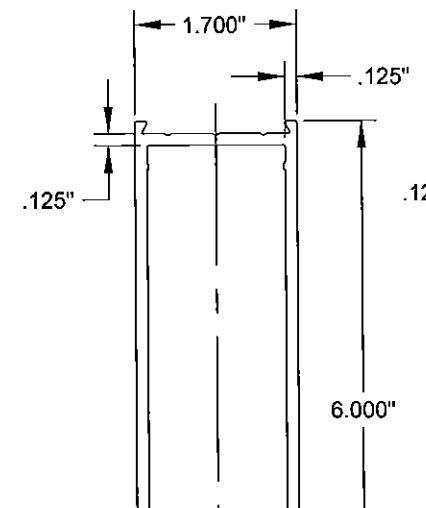


RAIL, BOTTOM - 6"
 PART NO.: 5-11-4036
 MATERIAL: 6063-T5 ALUM.
 SCALE: 1/2" = 1"

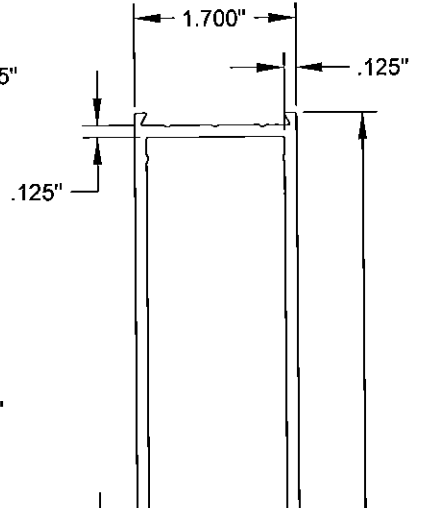


RAIL, BOTTOM - 10" (OPTIONAL)
 PART NO.: 5-51-4011
 MATERIAL: 6063-T5 ALUM.
 SCALE: 1/2" = 1"

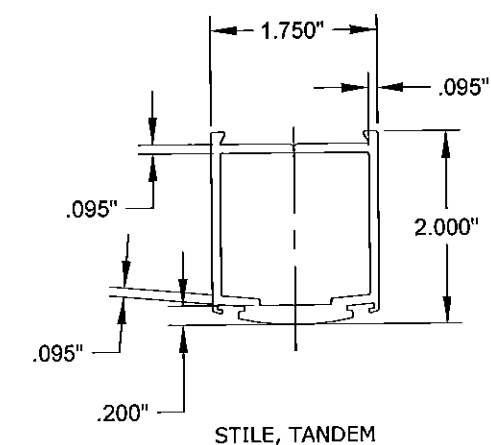


STILE, TANDEM
 PART NO.: 5-11-4021
 MATERIAL: 6063-T5 ALUM.
 SCALE: 1/2" = 1"

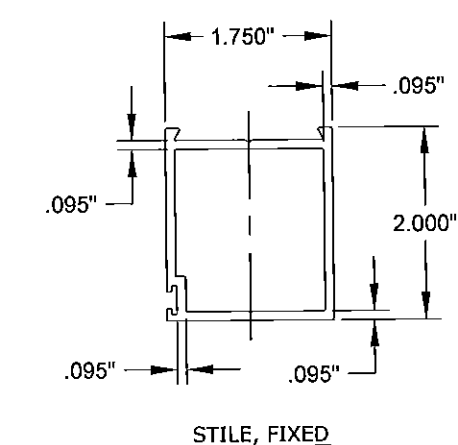


STILE, FIXED
 PART NO.: 5-11-4022
 MATERIAL: 6063-T5 ALUM.
 SCALE: 1/2" = 1"

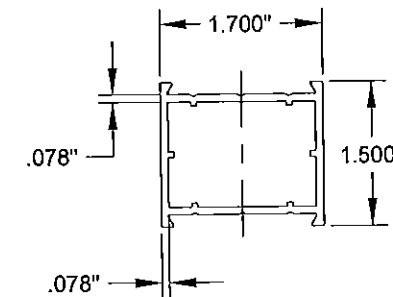


MUNTIN BAR
 PART NO.: 5-11-4031
 MATERIAL: 6063-T5 ALUM.
 SCALE: 1/2" = 1"

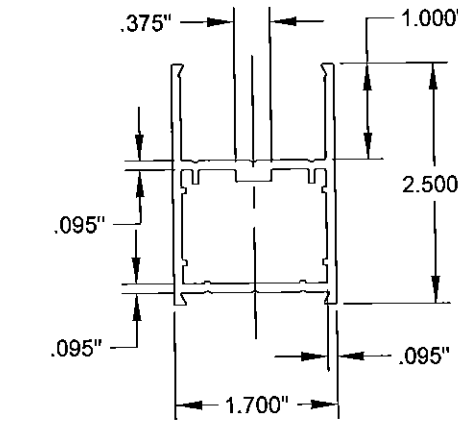


MUNTIN BAR (OPTIONAL)
 PART NO.: 5-11-4032
 MATERIAL: 6063-T5 ALUM.
 SCALE: 1/2" = 1"

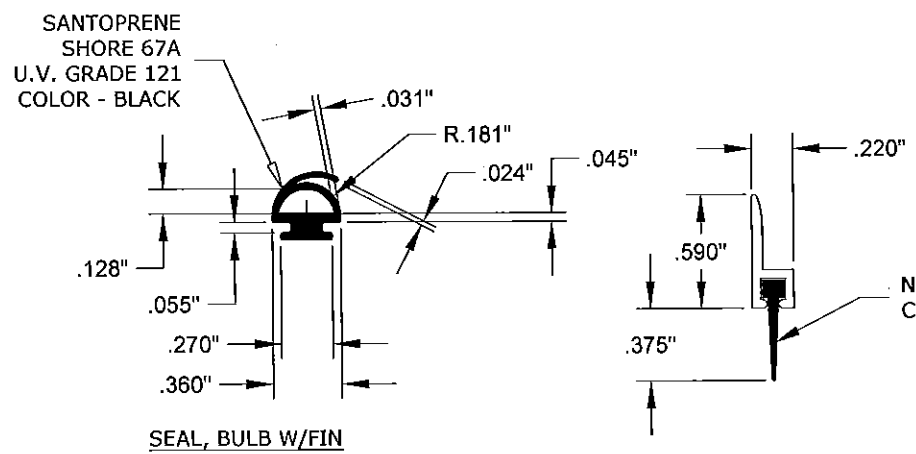


SEAL, BULB W/FIN
 PART NO.: 6-11-9009
 MATERIAL: ZERO INT'L. #870N
 SCALE: FULL

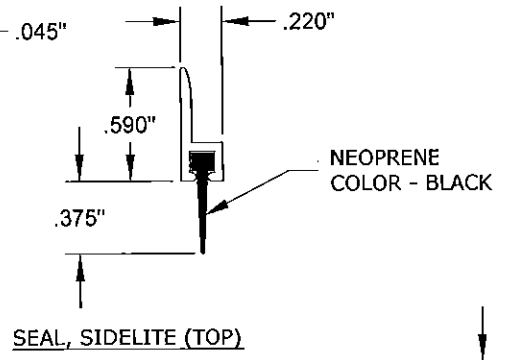

SEAL, SIDELITE (TOP)
 PART NO.: 9-99-7361
 MATERIAL: ZERO INT'L. 8194AA
 SCALE: FULL




WEATHER PILE W/FIN
 PART NO.: 9-99-7360
 MATERIAL: ULTRAFAB SOFT TOUCH FIN
 SCALE: FULL

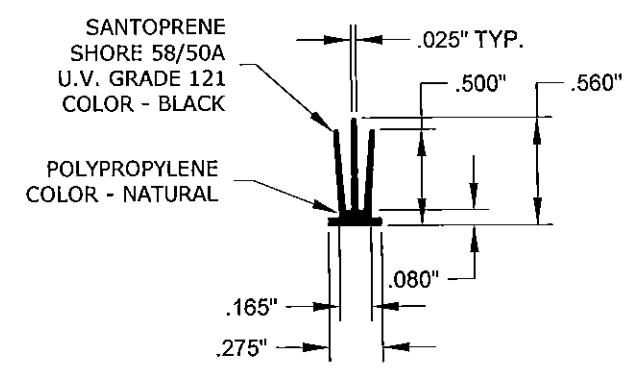


VINYL, SMOKE / AIR SEAL
 PART NO.: 6-59-9001
 MATERIAL: SEE ABOVE
 SCALE: FULL


NOTE: ALL ALUMINUM EXTRUSIONS SHALL HAVE A MINIMUM Fu=31 ksi & Fy=28200 psi.

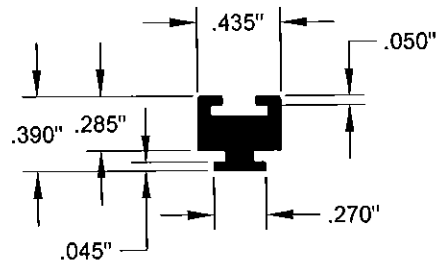

CHANNEL, WEATHER PILE
 PART NO.: 6-51-9002
 MATERIAL: GEON 8700 PVC
 SCALE: FULL

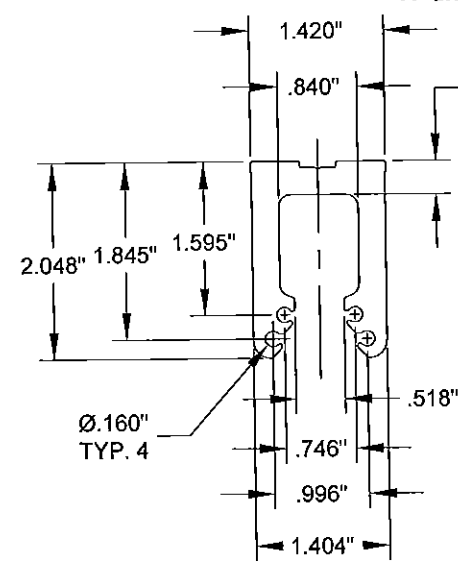

BLOCK, SHEAR
 PART NO.: 5-11-4027
 MATERIAL: 6063-T5 ALUM.
 SCALE: 1/2" = 1"

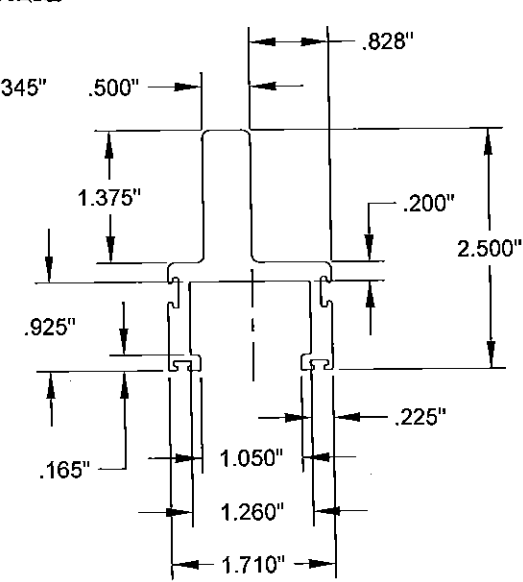

DOOR CATCH
 PART NO.: 5-51-4006
 MATERIAL: 6063-T5 ALUM.
 SCALE: 1/2" = 1"

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 15-03/6-04
 Expiration Date 3/17/20
 By [Signature]
 Miami Dade Product Control

FRANK L. BENNARDO, P.E.
 PE 00493
 FRANK L. BENNARDO, P.E.
 No. 46549
 PROFESSIONAL ENGINEER
 ENGINEERING EXPRESS
 160 SW 12th Avenue, Suite #106
 DEERFIELD BEACH, FL 33442
 Ph: (954) 354-0660 Fax: (954) 354-0665
 WWW.ENGP.COM
 CERT. OF AUTH. #9885
 A. FRANK L. BENNARDO, P.E., INC. INNOVATION

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212
 SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT. ISSUE	AML	KL	06/28/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-REL-0001)	KL	FLB	03/19/12
REV. FBC 2014	RWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
 SCALE:
 PAGE DESCRIPTION:
 17

V:\Projects\14-2163 NOA-Update 12-0403.06 (09-REL-0001) for 2014 FBC-Renewal\WP14-2163a_09-REL-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg

02/11/2015 - 11:23am rickn

CONSOLIDATED BILL OF MATERIALS

DESCRIPTION	record-usa PART NO.	MATERIAL	MANUFACTURER / REMARKS
TORQUE BAR ASS'Y.	4-51-0011		
WELDMENT, TORQUE BAR	4-51-0001		
PIVOT, TORQUE BAR BOTTOM	4-70-4104	2" X 2" X 3/8" ALUMINUM ANGLE	
PIVOT PIN, TORQUE BAR	4-70-1034	Ø3/8" X 1 3/8" STEEL CLEVIS PIN	
PIN, SPRING (TORQUE BAR)	9-99-3922	Ø3/16" X 1" STEEL SLOTTED SPRING PIN	
RETAINING RING, TORQUE BAR ASS'Y.	9-99-4625		ROTOR CLIP #SHR-98
BRACKET, TORQUE BAR SUPPORT	4-51-1003	3/16" C.R.S., ZINC PLATE	
PLATE, TORQUE BAR	4-51-1013	3/4" X 1 1/2" AISI 1018 COLD FINISHED FLAT BAR	
BAR, TORQUE	4-51-1014	Ø1.00" AISI 1018 ROUND STEEL BAR	
DOOR CATCH ASS'Y. - L.H.	4-51-0013		
DOOR CATCH ASS'Y. - R.H.	4-51-0027		
HOUSING, DOOR CATCH ASS'Y. - L.H.	4-51-1038	11 GA. (.1196) C.R.S., ZINC PLATE	
HOUSING, DOOR CATCH ASS'Y. - R.H.	4-51-1036	MAKE FROM 4-51-1038	
INTERLOCK, DOOR CATCH - L.H.	4-51-1039	10 GA. (.1345) C.R.S., ZINC PLATE	
INTERLOCK, DOOR CATCH - R.H.	4-51-1040	10 GA. (.1345) C.R.S., ZINC PLATE	
PLATE, DOOR INTERLOCK	4-51-1064	3/16" H.R.P.O., ZINC PLATE	
BALL PLUNGER ASS'Y.	4-70-0582		
PLUG, BALL PLUNGER	4-11-4090	Ø1 1/16" 6061-T6511 ALUMINUM ROUND BAR	
SPRING, BALL PLUNGER	9-99-5689	Ø.080 STEEL MUSIC WIRE, ZINC PLATE	
BALL, SPRING PLUNGER	9-99-0104	BALL, CHROME ALLOY STEEL, Ø5/8"	
HOUSING, BALL PLUNGER	4-11-2001	Ø3/4" FREE CUTTING BRASS ROUND ROD	
DOOR STOP ASS'Y.	4-51-0020		
BUMPER, DOOR STOP	9-99-2598	MEDIUM-HARD SRB RUBBER, SHORE 55A, BLACK	McMASTER CARR P/N 9310K124
BRACKET, DOOR STOP	4-51-1006	3/16" C.R.S., BLACK OXIDE	
DOOR INTERLOCK ASS'Y. - L.H.	4-51-0015		
DOOR INTERLOCK ASS'Y. - R.H.	4-51-0016		
PLATE, DOOR INTERLOCK ASS'Y.	4-51-1042	7 GA. (.1793) C.R.S., ZINC PLATE	
BRACKET, INTERLOCK ASS'Y.	4-51-1041	3/16" (.1875) C.R.S., ZINC PLATE	
PLUNGER, SPRING LOADED	9-99-0113		VLIER P/N NM-55N
CARRIER ROLLER ASS'Y.	4-51-0005		
BODY, CARRIER ROLLER	9-51-0002	PA6 - POLYAMIDE (NYLON) 6	

FRANK L. BENNARD, P.E.
 LICENSE # 029417905
 No. 46549
 PROFESSIONAL ENGINEERING EXPRESS
 STATE OF FLORIDA
 160 SW 12th AVE, SUITE 1106
 DEERFIELD BEACH, FL 33442
 Ph: (954) 354-0660 Fax: (954) 354-0661
 WWW.ENGEXP.COM
 CERT. OF AUTH. #9886
 A FRANK L. BENNARD, P.E., INC. INNOVATION

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212
 SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

PRODUCT REVISED
 to comply with the Florida
 Building Code
 Acceptance No 15-0316-04
 Expiration Date 3/17/20
 By Ishag L. Cheema
 Miami Dade Product Control

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	ANL	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/07/09
2010 FBC (09-REL-0001)	KL	FLB	03/19/12
REV FBC 2014	RWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARD, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARD, P.E. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
 SCALE:
 PAGE DESCRIPTION:
 18

CONSOLIDATED BILL OF MATERIALS

DESCRIPTION	record-usa PART NO.	MATERIAL	MANUFACTURER / REMARKS
BALL BEARING, CARRIER ROLLER	9-07-0049	6201-Z BALL BEARING	JESA W2
RETAINING RING, CARRIER ROLLER	9-99-4624		ROTOR CLIP #DHO-32
ROLLER ASS'Y., ANTI-RISE	9-99-3922		
ROLLER, ANTI-RISE	9-51-9006	DELIN, WHITE	
AXLE, ANTI-RISE ROLLER	4-51-7001	Ø½" TYPE 303 STAINLESS STEEL ROUND BAR	
RETAINING RING, ANTI-RISE ROLLER	9-99-4629		ROTOR CLIP #PO-50ST PA
PLATE ASS'Y. - CARRIER ROLLER	4-51-0002		
PLATE, CARRIER ROLLER	4-51-1020	10 GA. (.1345) C.R.S., ZINC PLATE	
NUT, PEM	9-99-6193		PEM #S0518-3, ZINC PLATE
PLATE SUB-ASS'Y., CARRIER ROLLER	4-51-0017		
SPACER, CARRIER ROLLER	4-51-1017	Ø⅝" O.D. X 13 GA. (.095) WALL MECHANICAL STEEL TUBING (D.O.M.)	
AXLE, CARRIER ROLLER	4-51-1021	Ø⅝" TYPE 303 STAINLESS STEEL ROUND BAR	
BRACKET, BELT BASE	4-51-1001	14 GA. (.0747) C.R.S., ZINC PLATE	
BRACKET, BELT CLASP	4-51-1002	14 GA. (.0747) C.R.S., ZINC PLATE	
CARRIER ASS'Y., SLAVE	4-51-0090		
CARRIER ASS'Y., UPPER BELT	4-51-0091		
CARRIER ASS'Y., LOWER BELT	4-51-0092		
SCREW, M6 X 10 HFHCS	9-99-1812		
SCREW, M6 X 12 HFHCS	9-99-1820		
WASHER, LOCK - ⅝"	9-99-7235		
WASHER, FLAT - ⅝"	9-99-7311		
SCREW, ⅝-18 X 1½" HHCS, GR. 8	81-0018-3726		
BRACKET, ANTI-DERAIL	4-51-1063	10 GA. (.1345) C.R.S., ZINC PLATE	
PLATE, CARRIER ASS'Y. - SLAVE	4-51-1001	¼" C.R.S., ZINC PLATE	
PLATE, BELT RETAINER (LOWER)	4-51-1019	¼" C.R.S., ZINC PLATE	
PLATE, BELT RETAINER (UPPER)	4-51-1018	¼" C.R.S., ZINC PLATE	
BRACKET, SIDELITE STRIKE	4-51-1010	11 GA. (.1196) TYPE 304 STAINLESS STEEL	
BLOCK, UPPER SIDELITE PIVOT	4-51-4152	⅝" X 1¼" 6061-T6511 EXTRUDED ALUMINUM RECTANGULAR BAR	
PLATE, NUT	4-51-1037	10 GA. (.1345) C.R.S., ZINC PLATE	
BRACKET, HEADER MOUNTING - L.H.	4-51-1055	11 GA. (.1196) C.R.S., ZINC PLATE	
BRACKET, HEADER MOUNTING - R.H.	4-51-1056	11 GA. (.1196) C.R.S., ZINC PLATE	

FRANK L. BENNARDO, P.E.
 # 0211-0001
RECORD-USA LICENSE
 No. 46549
 STATE OF FLORIDA
 PROFESSIONAL ENGINEERING
 EXPRESSION OF OPINION
 160 SW 12th AVENUE #106
 DEERFIELD BEACH, FL 33442
 PH: (954) 354-0660 FAX: (954) 354-0669
 WWW.ENGEXP.COM
 CERT. OF AUTH. #8885
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212

SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No. 15-0316.04
 Expiration Date 3/17/20
 By Frank L. Bennardo
 Miami Dade/Product Control

REMARKS	DRWN	CHKD	DATE
INIT. ISSUE	AML	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-RELU-0001)	KL	FLB	03/19/12
REV. FBC 2014	RWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
 SCALE:
 PAGE DESCRIPTION:
 19

V:\Projects\14-2163 NOA-Update 12-04-03.06 (09-REU-0001) for 2014 FBC-Renewal\WP14-2163a_09-REU-0001_02a 5400 LMT HR Sliders (NOA) - Revised Per Comments.dwg 02/11/2015 - 11:23am rickn

CONSOLIDATED BILL OF MATERIALS

DESCRIPTION	record-usa PART NO.	MATERIAL	MANUFACTURER / REMARKS
END CAP, DOOR CATCH	4-51-1049	11 GA. (.1196) C.R.S., BLACK POWDER COAT	
END CAP, DOOR CATCH (POSITIVE LATCH)	4-59-1020	MAKE FROM 4-51-1019	
BRACKET, BALL PLUNGER	4-70-4342	1 1/4" X 1 1/4" X 3/16" 6063-T52 ALUMINUM ANGLE	
BLOCK, GLASS SETTING	6-11-9007	GEON 8700 PVC, DUROMETER 97 SHORE A, BLACK	
BLOCK, GLASS SPACER	6-11-9002	GEON 8700 PVC, DUROMETER 97 SHORE A, BLACK	
BOTTOM GUIDE ASS'Y.	4-51-0093		
BLOCK, BOTTOM GUIDE ASS'Y.	4-51-4267	1 1/4" 6061-T6 EXTRUDED ALUMINUM SQUARE BAR	
PIN, BOTTOM GUIDE	4-51-7007	Ø5/8" TYPE 304 STAINLESS STEEL ROUND BAR	
SPRING, COMPRESSION (BOTTOM GUIDE)	9-99-5693	Ø.045 TYPE 302 STAINLESS STEEL WIRE	McMASTER CARR P/N 9435K126
SCREW, SHOULDER (BOTTOM GUIDE)	9-99-1820	TYPE 18-8 STAINLESS STEEL	McMASTER CARR P/N 91327A165
BUSHING, FLANGED (BRONZE)	9-99-0233	ALLOY 932 (SAE 660) BRONZE	McMASTER CARR P/N 7815K18
BLOCK, FLUSHBOLT SUPPORT	4-51-4265	1 1/4" 6061-T6 EXTRUDED ALUMINUM SQUARE BAR	
BLOCK, HEX BOLT GUIDE	4-51-4266	1/2" X 1 1/4" 6061-T6511 EXTRUDED ALUMINUM RECTANGULAR BAR	
SPRING, COMPRESSION (EXIT DEVICE TOP BOLT)	9-99-5692	Ø.042 STEEL MUSIC WIRE, ZINC PLATE	McMASTER CARR P/N 9434K8
LOCK BOLT, EXIT DEVICE	4-11-1059	3/8" AISI 12L14 STEEL HEX BAR STOCK, ZINC PLATE	
HEX BOLT, THRESHOLD	4-51-7008	Ø1/2" TYPE 304 STAINLESS STEEL HEX BAR STOCK	
BLOCK, SHEAR (MACHINED)	4-11-4098	MAKE FROM 5-11-4027	
BLOCK, SHEAR (MACHINED)	4-51-4151	MAKE FROM 5-11-4027	
BLOCK, SHEAR (MACHINED)	4-11-4096	MAKE FROM 5-11-4027	
PLATE, BACKER	4-11-1082	7 GA. (.1793) C.R.S., ZINC PLATE	
BRACKET, ANTI-DERAIL	4-51-1063	10 GA. (.1345) C.R.S., ZINC PLATE	
ANGLE, SIDELITE PIVOT (TOP)	4-11-1086	3" X 2" X 5/16" STEEL ANGLE, SILVER METALLIC PAINT	
BUSHING, SIDELITE PIVOT (TOP)	9-99-0203	SAE 841 SINTERED BRONZE	
ANGLE, SIDELITE PIVOT (BOTTOM)	4-51-1067	3" X 2" X 5/16" STEEL ANGLE, SAFETY YELLOW PAINT	
BUSHING, SIDELITE PIVOT (BOTTOM)	4-51-7003	Ø7/8" TYPE 304 STAINLESS STEEL ROUND BAR	
DOOR INTERLOCK	4-51-7002	10 GA. (.1345) TYPE 304 STAINLESS STEEL	
MOUNTING STRAP	4-40-1002	3/16" H.R.P.O., ZINC PLATE	
WELDMENT, REINFORCEMENT CHANNEL	4-51-0029		SILVER METALLIC PAINT
CHANNEL, REINFORCEMENT (LOCK STILE)	4-51-1065	1 1/2" X 1/2" X 1/8" BAR CHANNEL, M 1020 - MERCHANT QUALITY	
PLATE, REINFORCEMENT CHANNEL	4-51-1007	3/8" X 1" AISI 1018 C.R.S. FLAT BAR	
CHANNEL, REINFORCEMENT (PIVOT STILE)	4-51-1066	1 1/2" X 1/2" X 1/8" BAR CHANNEL, M 1020 - MERCHANT QUALITY	SILVER METALLIC PAINT

PRODUCT REVISED
 to comply with the Florida
 Building Code
 Acceptance No. 15-0316-04
 Expiration Date 3/17/15
By: [Signature]
 Miami Dade Product Control

FRANK L. BENNARDO, P.E.
 LICENSE NO. 02/18/2009
 No. 46549

PROFESSIONAL ENGINEER OF RECORD

EXPRESS

160 SW 12th Avenue, #106
 DEERFIELD BEACH, FL 33442
 Ph: (954) 354-0660 Fax: (954) 354-0663
 WWW.ENGEXP.COM
 CERT OF AUTH #9886
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212

SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	AML	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-REU-0001)	KL	FLB	03/19/12
REV FBC 2014	RWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163

SCALE: -

PAGE DESCRIPTION:

20

23

V:\Projects\14-2163 NOA-Update 12-04-03.06 (09-REU-0001) for 2014 FBC-Renewal\WP11-2163a_09-REU-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg 02/11/2015 - 11:23am rickn

CONSOLIDATED BILL OF MATERIALS

DESCRIPTION	record-usa PART NO.	MATERIAL	MANUFACTURER / REMARKS
CHANNEL, REINFORCEMENT (BEAM STILE)	4-51-1068	1½" X ½" X ⅛" BAR CHANNEL, M 1020 - MERCHANT QUALITY	SILVER METALLIC PAINT
CHANNEL, REINFORCEMENT (PIVOT STILE - SIDELITE)	4-51-1069	1½" X ½" X ⅛" BAR CHANNEL, M 1020 - MERCHANT QUALITY	SILVER METALLIC PAINT
PIN GUIDE THRESHOLD ASS'Y. - L.H.	4-51-0160		
PIN GUIDE THRESHOLD ASS'Y. - R.H.	4-51-0161		
PIN GUIDE THRESHOLD MACHINING - L.H.	4-51-4260	MAKE FROM 5-11-4008	
PIN GUIDE THRESHOLD MACHINING - R.H.	4-51-4261	MAKE FROM 5-11-4008	
PLATE, PIN GUIDE SUPPORT	4-51-7005	¾" X 1" TYPE 303 STAINLESS STEEL RECTANGULAR BAR	
BUMPER, PIN GUIDE	9-70-0077	NYLATRON® GS	
PIN, SIDELITE PIVOT (BOTTOM)	4-11-1031	¾" AISI 12L14 STEEL HEX BAR STOCK, ZINC PLATE	
BAR, ALIGNMENT (PIN GUIDE THRESHOLD)	4-51-4009	½" X ⅝" 6061-T5 ALUMINUM RECTANGULAR BAR	
BLOCK, SIDELITE PIVOT (BOTTOM)	4-51-4265	¾" X 1" 6061-T5 ALUMINUM RECTANGULAR BAR	
THRESHOLD ASS'Y., BIPART	4-51-0164		
THRESHOLD MACHINING	4-51-4264	MAKE FROM 5-51-4021	
STRIKE PLATE, LOCKBOLT	4-51-7006	½" X 1" TYPE 303 STAINLESS STEEL RECTANGULAR BAR	POLYMER CORP. PROFILE 40-101
HEADER	5-51-4001	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
COVER, HEADER	5-51-4002	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
FILLER, HEADER SOFFIT	5-51-4003	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
ROLLER TRACK	5-51-4004	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
SIDE JAMB	5-60-1418	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
FILLER, SIDE JAMB	5-60-1532	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
PIN GUIDE, RAMPED	5-11-4008	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
THRESHOLD, SADDLE	5-51-4021	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
RAIL, TOP (SX PANEL)	5-51-4009	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
RAIL, TOP (SO PANEL)	5-11-4034	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
RAIL, BOTTOM - 6"	5-11-4036	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
RAIL, BOTTOM - 10" (OPTIONAL)	5-51-4011	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
STILE, TANDEM	5-11-4021	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
STILE, FIXED	5-11-4022	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
MUNTIN BAR	5-11-4031	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
MUNTIN BAR (OPTIONAL)	5-11-4032	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
DOOR CATCH	5-51-4006	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.

PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No. 15-0316-04
Expiration Date 3/17/20
By: *Shang L. Chen*
Miami Dade Product Control

FRANK L. BENNARDO, P.E.
P.E. 046549
LICENSE
No. 46549
PROFESSIONAL ENGINEER
STATE OF FLORIDA
160 SW 12th AVE, SUITE #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH. #8988
A. FRANK L. BENNARDO, P.E., INC. INNOVATION

RECORD-USA
4324 HARGETT COURT
MONROE, NC 28110
(704) 289 - 9212
SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
LARGE MISSILE IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	AMIL	KL	06/26/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-REU-0001)	KL	FLB	03/19/12
REV FBC 2014	RWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
SCALE: -
PAGE DESCRIPTION:
21

V:\Projects\14-2163 NOA-Update 12-0409.06 (09-REU-0001) for 2014 FBC-Renewal\WP14-2163a_09-REU-0001_02a 5400 LMI HR Sliders (NOA) - Revised Per Comments.dwg 02/11/2015 - 11:23am rickn

CONSOLIDATED BILL OF MATERIALS

DESCRIPTION	record-usa PART NO.	MATERIAL	MANUFACTURER / REMARKS
BLOCK, SHEAR	5-11-4027	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
GUTTER, HURRICANE	5-11-4044	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
SASH, SQUARE	5-11-4040	6063-T5 ALUMINUM	BONNELL ALUMINUM, INC.
GLAZING BULB	6-11-9011	SANTOPRENE / POLYPROPYLENE COEXTRUSION	CENTRAL PLASTICS, INC.
CHANNEL, WEATHER PILE	6-51-9002	GEON 8700 PVC	UNITED PLASTICS CORP.
WEATHER PILE W/FIN	9-99-7360	ULTRAFAB SOFT TOUCH FIN	ULTRAFAB, INC. P/N W31565NK0000
VINYL, SMOKE / AIR SEAL	6-59-9001	SANTOPRENE / POLYPROPYLENE COEXTRUSION	CENTRAL PLASTICS, INC.
SEAL, BULB W/FIN	6-11-9009	SANTOPRENE SHORE 67A, U.V. GRADE 121	ZERO INTERNATIONAL #870N
SEAL, SIDELITE (TOP)	9-99-7361	NEOPRENE FIN WITH ALUMINUM HOUSING	ZERO INTERNATIONAL #8194AA
DAMPER, ROLLER TRACK	9-51-0001	EPDM SHORE 85±5A, BLACK	CENTRAL PLASTICS, INC.
FLUSHBOLT, CYLINDER OPERATED	9-99-0067	ADAMS RITE 1871-2	ADAMS RITE MANUFACTURING CO.
HEADER BOLT SET	9-99-0075	INTERNATIONAL DOOR CLOSER INC. HB-4015-N	INTERNATIONAL DOOR CLOSER INC.
MORTISE KEY CYLINDER	9-99-0068	INTERNATIONAL DOOR CLOSER INC. CZ-1001	INTERNATIONAL DOOR CLOSER INC.
MORTISE THUMBTURN	9-99-0069	INTERNATIONAL DOOR CLOSER INC. TZ-3001	INTERNATIONAL DOOR CLOSER INC.
EXIT DEVICE, G86 C.V.R.	9-99-0094	ADAMS RITE G86 C.V.R. EXIT DEVICE	ADAMS RITE MANUFACTURING CO.
ESCUTCHEON, MORTISE KEY CYLINDER	9-99-0098	ADAMS RITE 8651 ESCUTCHEON	ADAMS RITE MANUFACTURING CO.
SCREW, 5/16-18 X 1" FSHCS	81-0011-2720		
SCREW, 10-32 X 3/8" PFHMS	81-0011-0558		
SCREW, 10-32 X 1/4" PFHMS	81-0011-0554		
SCREW, 10-32 X 1/2" PFHMS	81-0011-0562		
SCREW, 1/4-20 X 3/8" BFHCS	81-0017-2658		
SCREW, M6 X 16 HFHCS	9-99-1813		
SCREW, 1/4-20 X 1/2" PFHMS	81-0011-0662		
LOCK WASHER, SPLIT, #10	9-99-7249		
SCREW, 10-32 X 3/8" SHCS	81-0016-2258		
WASHER, 1/4" FLAT	9-99-7346		
WASHER, 1/4" LOCK SPLIT	9-99-7161		
SCREW, 1/4-20 X 1" HHMS - GR. 8	81-0088-3670		
SCREW, 10-32 X 1/2" SHCS	81-0016-2562		
SCREW, 8-18 X 1/2" PFHMS, TYPE B	81-3511-0412-DB		
SCREW, 1/4-20 X 3/8" SFCHCS	81-0011-2658		

FRANK L. BENNARDO, P.E.
 LICENSE NO. 246549
 ENGINEERING EXPRESS, INC.
 160 SW 12th AVENUE, SUITE 106
 DEERFIELD BEACH, FL 33442
 Ph: (954) 354-0660 Fax: (954) 354-0661
 WWW.ENGEXP.COM
 CERT. OF AUTH. #885
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212

SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

PRODUCT REVIEWED
 is complying with the Florida
 Building Code
 Acceptance No 15-0316-04
 Expiration Date 3/17/20
 By Ishag I. Chaudhry
 Miami Dade Product Control

REMARKS	DATE	DRWN	CHKD
INT ISSUE	08/26/09	AML	KL
REV. PER BCCO COMMENT	12/01/09	FLB	KL
2010 FBC (09-REU-0001)	03/19/12	FLB	CSL
REV. FBC 2014	02/09/15	RWN	CSL


THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163
 SCALE:
 PAGE DESCRIPTION:
 22

CONSOLIDATED BILL OF MATERIALS

DESCRIPTION	record-usa PART NO.	MATERIAL	MANUFACTURER / REMARKS
SCREW, 1/4-20 X 1" SFCHCS	81-0011-2670		
SCREW, 10-24 X 3/4" PFHSMS, TYPE 23	81-4411-0516		
SCREW, 1/4-20 X 3" PPHMS	81-0014-0688		
SCREW, 1/4-20 X 3/4" HWHMS, GR. 8	81-0017-3666		
SCREW, 1/4-20 X 3/8" BSHCS - S.S.	81-0016-2658		
SCREW, 1/4-20 X 1" BSHCS - S.S.	81-0014-2670		
SCREW, 1/4-20 X 1/2" HWHMS, GR. 8	81-0017-3662		
SCREW, 1/4-20 X 5/8" HWHMS, GR. 8	81-0017-3664		
SCREW, 10-32 X 1/2" PFHMS	81-0011-0562		
SCREW, 1/4-20 X 3/4" HHMS, GR. 5 W/NYLOC STRIP	81-0718-3666		

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 15-0316-04
 Expiration Date MAR 17, 2020
 By Frank L. Benardo
 Miami Dade Product Control

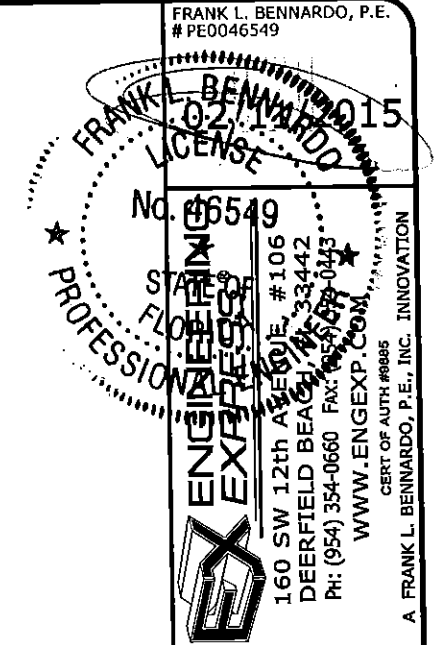

RECORD-USA
 4324 HARGETT COURT
 MONROE, NC 28110
 (704) 289 - 9212

SERIES 5400 ALUMINUM AUTOMATIC SLIDING GLASS DOORS
 LARGE MISSILE IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	AML	KL	06/28/09
REV. PER BCCO COMMENT	KL	FLB	12/01/09
2010 FBC (09-REL-0001)	KL	FLB	03/19/12
REV. FBC 2014	IRWN	CSL	02/09/15

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENARDO, P.E. - ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

14-2163

SCALE: -

PAGE DESCRIPTION:

23